


GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 12 June 2012	15,603 MW	15,665 MW	0.40%	
Energy Demand for 12 June 2012	326.12 GWh	326.04 GWh	-0.02%	
Highest Maximum Demand (16 May 2012)	15,556 MW	15,723 MW	1.07%	*New MD
Highest Daily Energy Demand (16 May 2012)	325.75 GWh	325.23 GWh	-0.16%	*New Energy

Prepared by:
Electricity Market Operations
Electricity Supply & Market Regulations Dept.
Energy Commission Malaysia
13-Jun-12


Daily Owners' Mix for 12 June 2012

TNB	63,615 MWh
IPP	260,275 MWh
Co-Gen	1,894 MWh
Interconnection*	(251) MWh

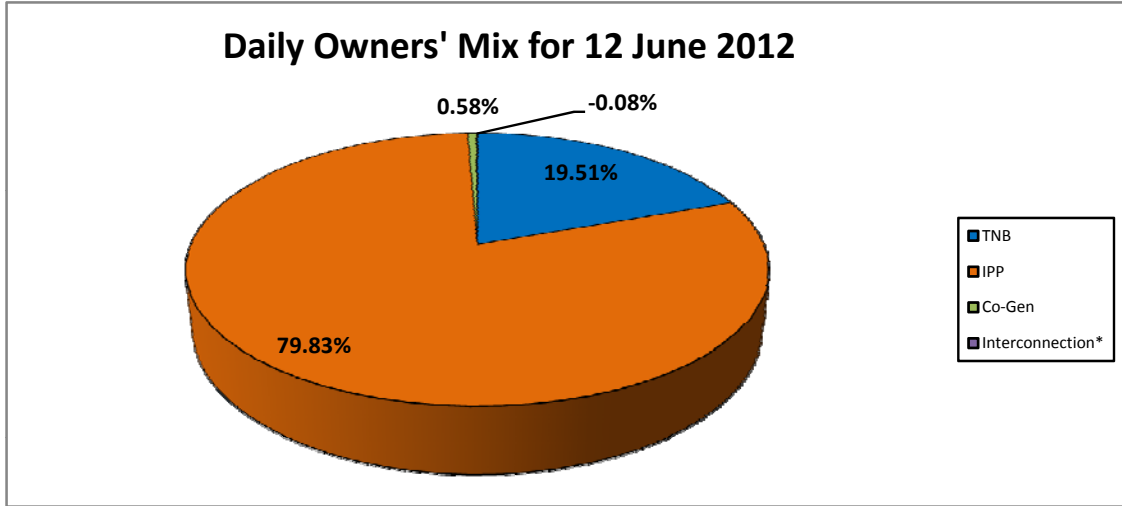

Daily Generation Mix for 12 June 2012

ST-Coal	147,798 MWh
ST-Oil	12,620 MWh
ST-Gas	- MWh
Gas	149,929 MWh
Hydro	13,543 MWh
Distillate	- MWh
Co-Gen	1,894 MWh
SPORE*	451 MWh
EGAT*	(702) MWh

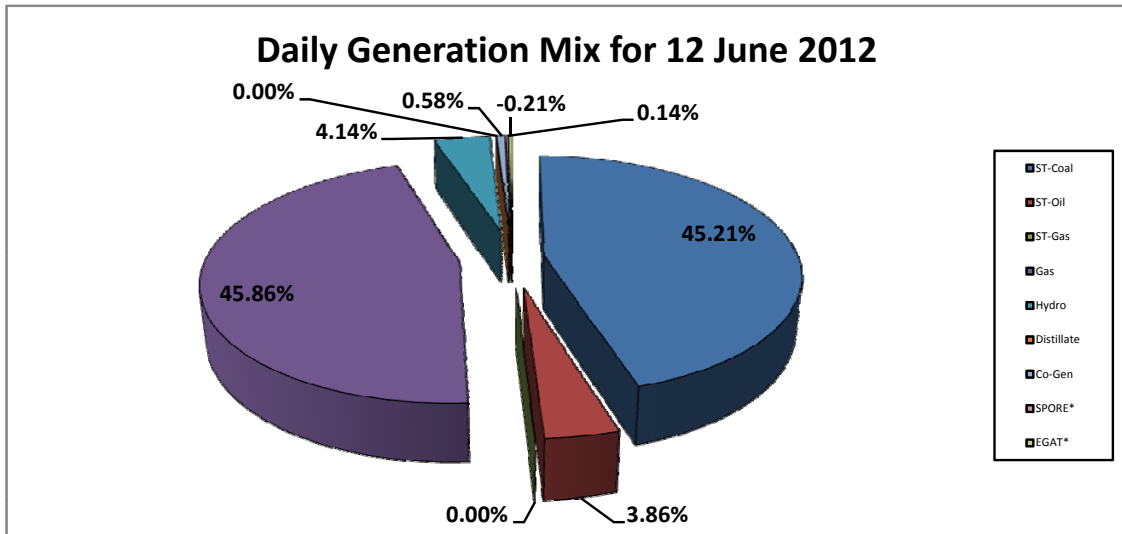

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand