

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 15 June 2012	15,323 MW	15,443 MW	0.78%	
Energy Demand for 15 June 2012	322.95 GWh	323.86 GWh	0.28%	
Highest Maximum Demand (16 May 2012)	15,556 MW	15,723 MW	1.07%	*New MD
Highest Daily Energy Demand (13 June 2012)	326.27 GWh	328.13 GWh	0.57%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

16-Jun-12


Daily Owners' Mix for 15 June 2012

TNB	63,461 MWh
IPP	258,151 MWh
Co-Gen	1,964 MWh
Interconnection*	(287) MWh

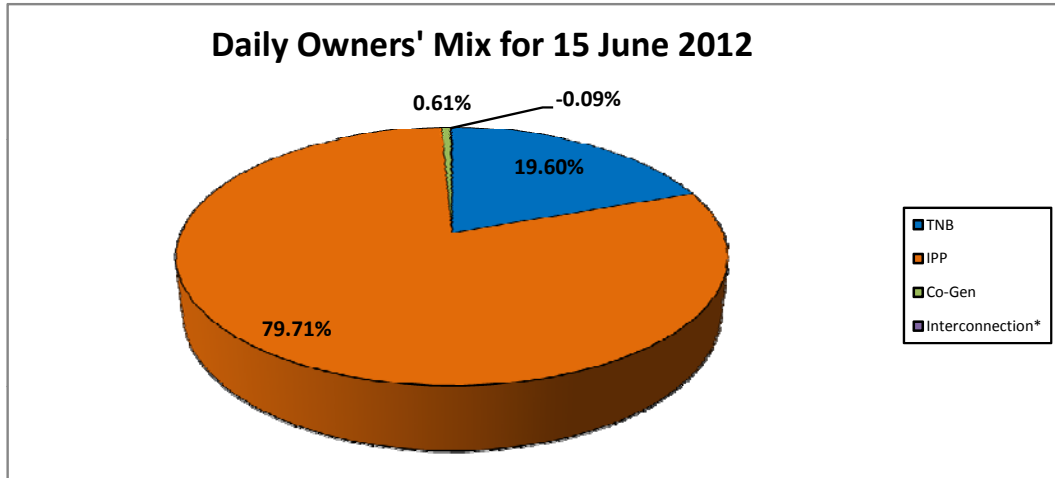

Daily Generation Mix for 15 June 2012

ST-Coal	151,066 MWh
ST-Oil	6,598 MWh
ST-Gas	93 MWh
Gas	134,429 MWh
Hydro	13,781 MWh
Distillate	15,645 MWh
Co-Gen	1,964 MWh
SPORE*	414 MWh
EGAT*	(701) MWh

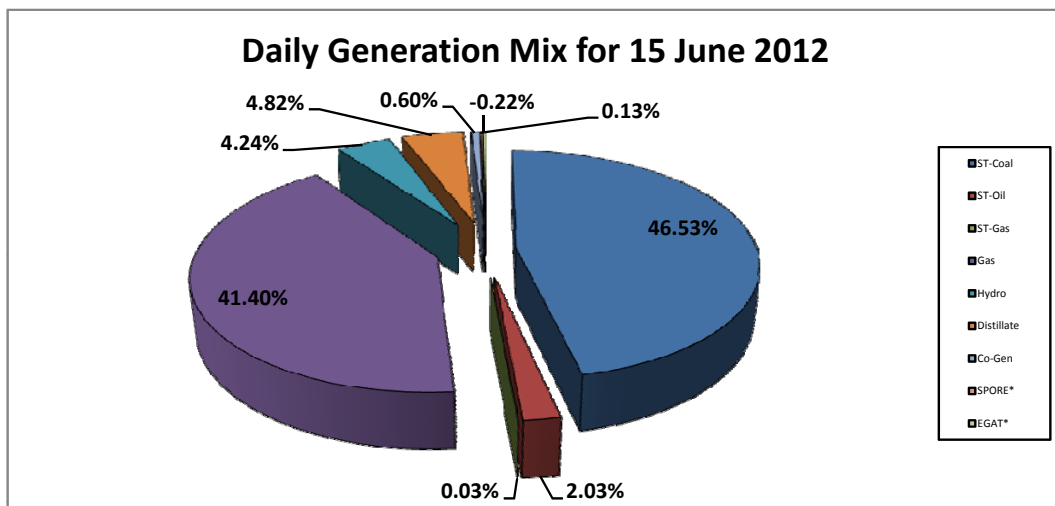

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand