

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 16 June 2012	13,206 MW	13,698 MW	3.73%	
Energy Demand for 16 June 2012	294.95 GWh	301.50 GWh	2.22%	
Highest Maximum Demand (16 May 2012)	15,556 MW	15,723 MW	1.07%	*New MD
Highest Daily Energy Demand (13 June 2012)	326.27 GWh	328.13 GWh	0.57%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

17-Jun-12


Daily Owners' Mix for 16 June 2012

TNB	58,246	MWh
IPP	241,486	MWh
Co-Gen	1,768	MWh
Interconnection*	-	MWh

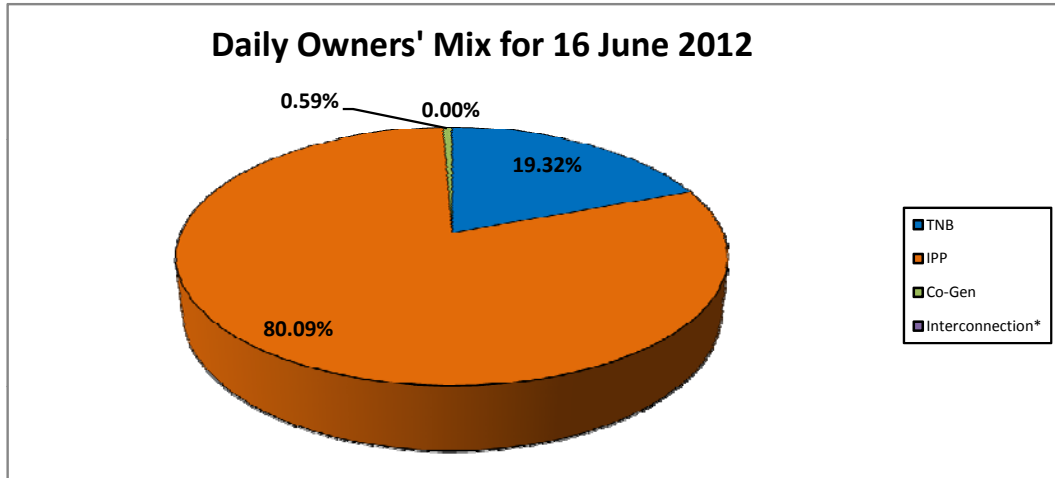

Daily Generation Mix for 16 June 2012

ST-Coal	151,419	MWh
ST-Oil	6,653	MWh
ST-Gas	-	MWh
Gas	123,012	MWh
Hydro	14,665	MWh
Distillate	3,983	MWh
Co-Gen	1,768	MWh
SPORE*	-	MWh
EGAT*	-	MWh

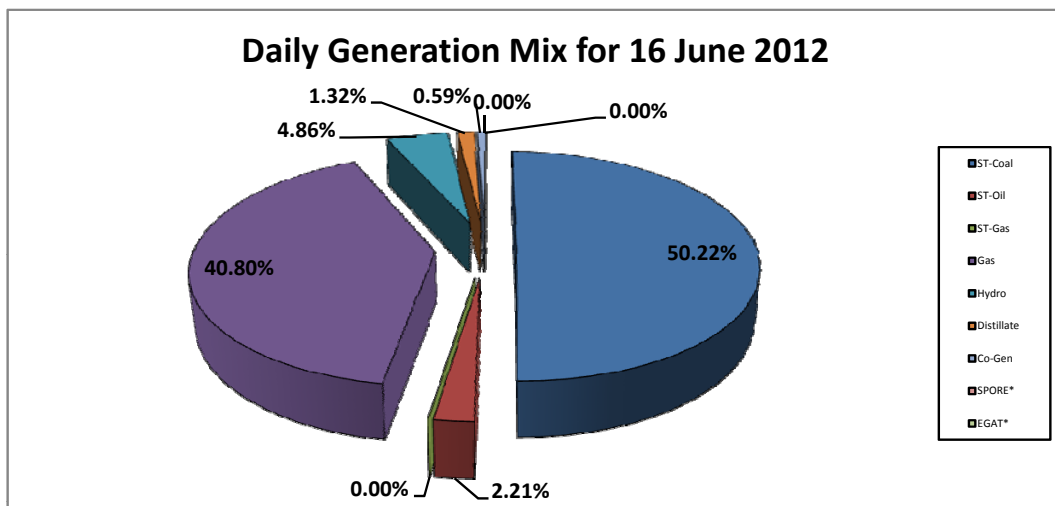

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand