

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 17 June 2012	12,776 MW	13,077 MW	2.36%	
Energy Demand for 17 June 2012	272.03 GWh	280.15 GWh	2.98%	
Highest Maximum Demand (16 May 2012)	15,556 MW	15,723 MW	1.07%	*New MD
Highest Daily Energy Demand (13 June 2012)	326.27 GWh	328.13 GWh	0.57%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

18-Jun-12


Daily Owners' Mix for 17 June 2012

TNB	47,205 MWh
IPP	231,487 MWh
Co-Gen	1,833 MWh
Interconnection*	375 MWh

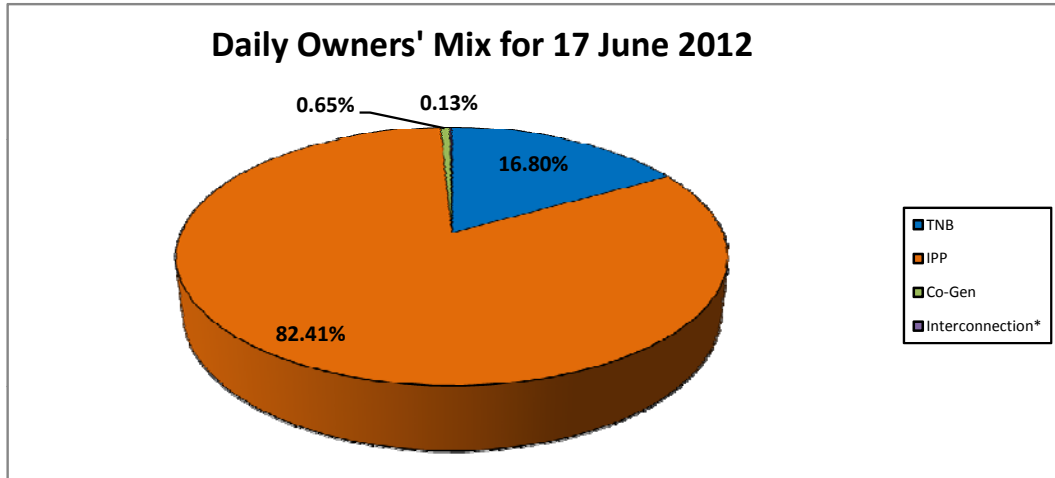

Daily Generation Mix for 17 June 2012

ST-Coal	150,989 MWh
ST-Oil	6,385 MWh
ST-Gas	- MWh
Gas	109,293 MWh
Hydro	11,765 MWh
Distillate	260 MWh
Co-Gen	1,833 MWh
SPORE*	(64) MWh
EGAT*	439 MWh

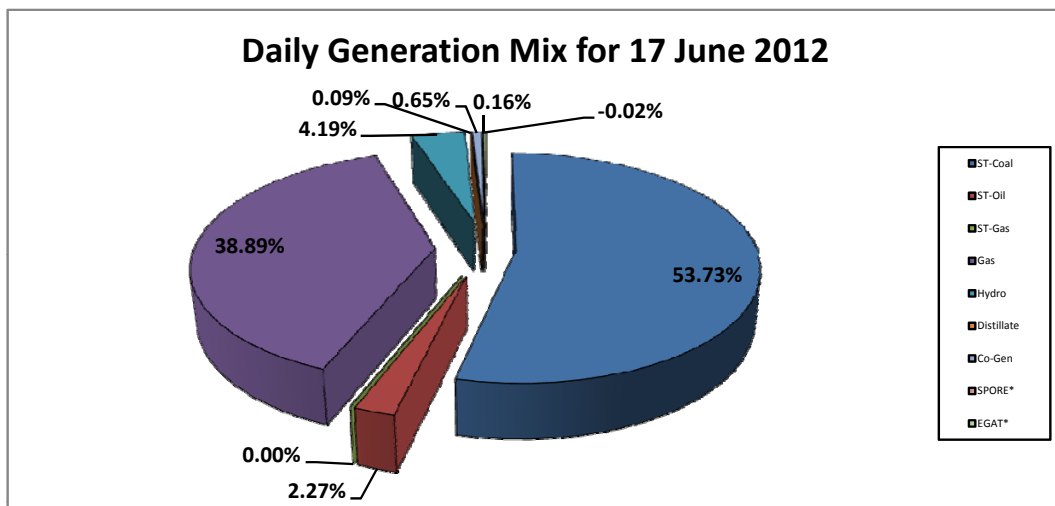

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand