

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 18 June 2012	15,644 MW	15,611 MW	-0.21%	
Energy Demand for 18 June 2012	321.09 GWh	320.48 GWh	-0.19%	
Highest Maximum Demand (16 May 2012)	15,556 MW	15,723 MW	1.07%	*New MD
Highest Daily Energy Demand (13 June 2012)	326.27 GWh	328.13 GWh	0.57%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

19-Jun-12


Daily Owners' Mix for 18 June 2012

TNB	66,628	MWh
IPP	253,322	MWh
Co-Gen	1,780	MWh
Interconnection*	1,250	MWh

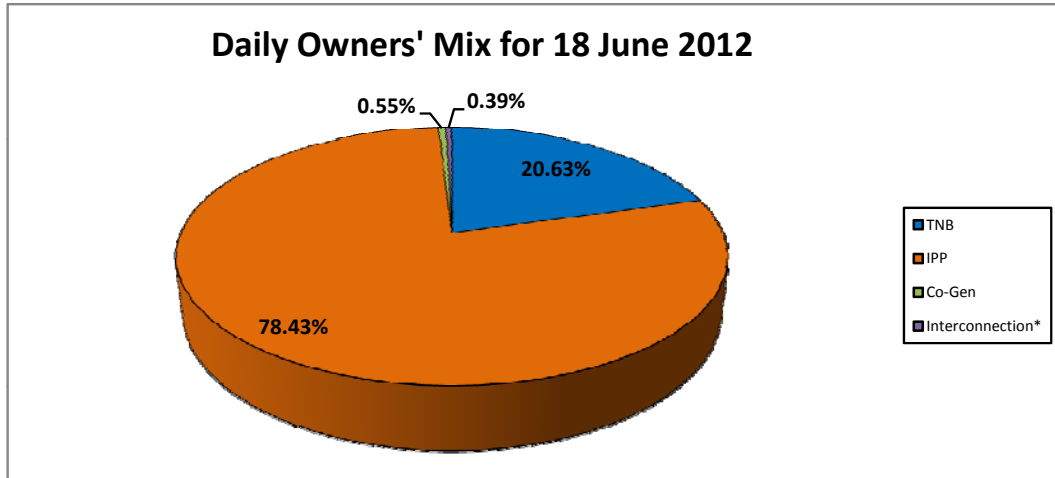

Daily Generation Mix for 18 June 2012

ST-Coal	151,479	MWh
ST-Oil	6,598	MWh
ST-Gas	-	MWh
Gas	148,412	MWh
Hydro	13,461	MWh
Distillate	-	MWh
Co-Gen	1,780	MWh
SPORE*	613	MWh
EGAT*	637	MWh

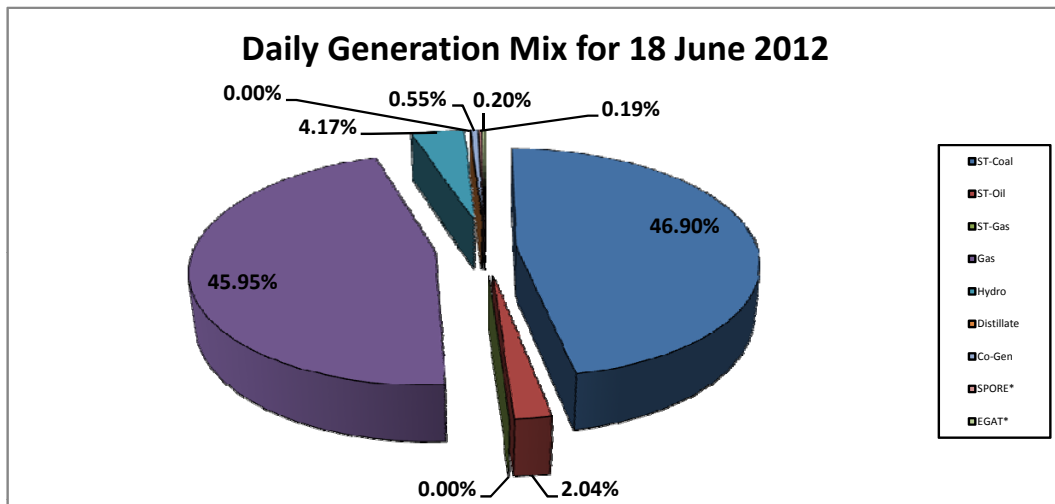

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand