

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 20 June 2012	15,685 MW	15,826 MW	0.90%	*New MD
Energy Demand for 20 June 2012	326.75 GWh	328.72 GWh	0.60%	*New Energy
Highest Maximum Demand (16 May 2012)	15,556 MW	15,723 MW	1.07%	
Highest Daily Energy Demand (13 June 2012)	326.27 GWh	328.13 GWh	0.57%	

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

21-Jun-12


Daily Owners' Mix for 20 June 2012

TNB	73,039 MWh
IPP	154,692 MWh
Co-Gen	1,823 MWh
Interconnection*	838 MWh

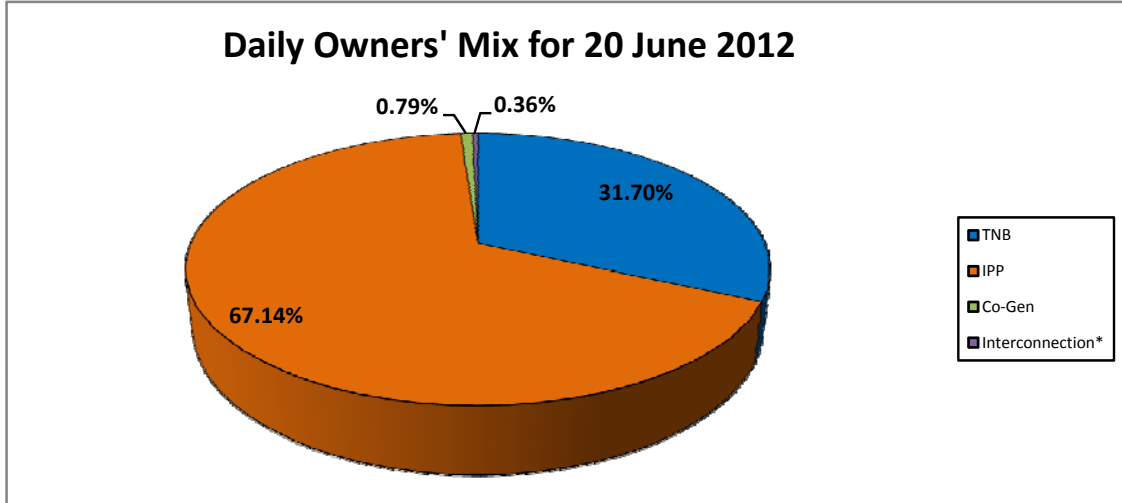

Daily Generation Mix for 20 June 2012

ST-Coal	143,990 MWh
ST-Oil	8,742 MWh
ST-Gas	- MWh
Gas	145,830 MWh
Hydro	13,547 MWh
Distillate	15,622 MWh
Co-Gen	1,823 MWh
SPORE*	112 MWh
EGAT*	726 MWh

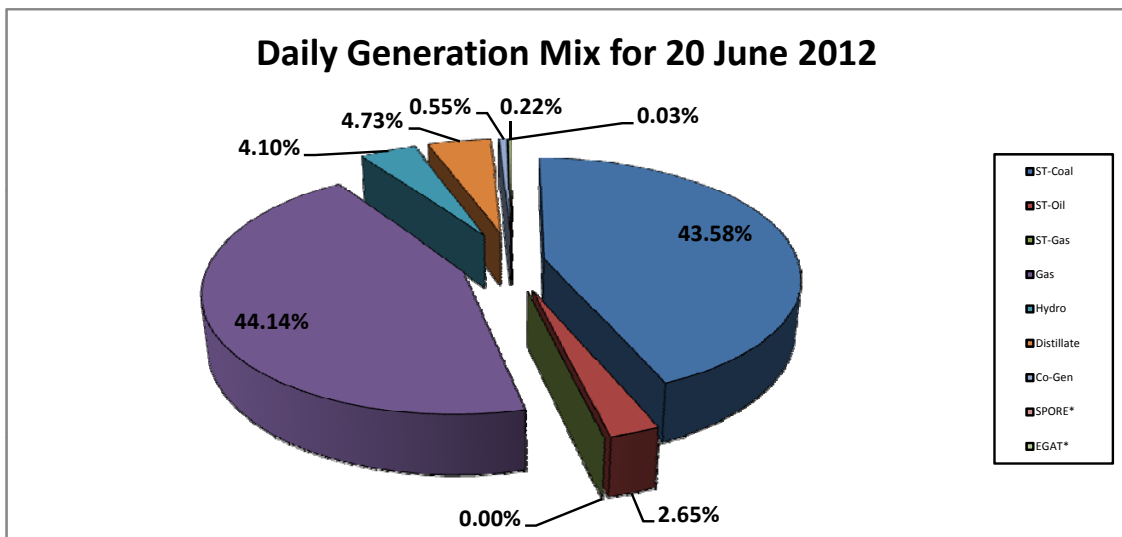

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand