

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 23 June 2012	13,446 MW	13,756 MW	2.31%	
Energy Demand for 23 June 2012	298.44 GWh	302.46 GWh	1.35%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

24-Jun-12


Daily Owners' Mix for 23 June 2012

TNB	60,075 MWh
IPP	240,845 MWh
Co-Gen	1,913 MWh
Interconnection*	365 MWh

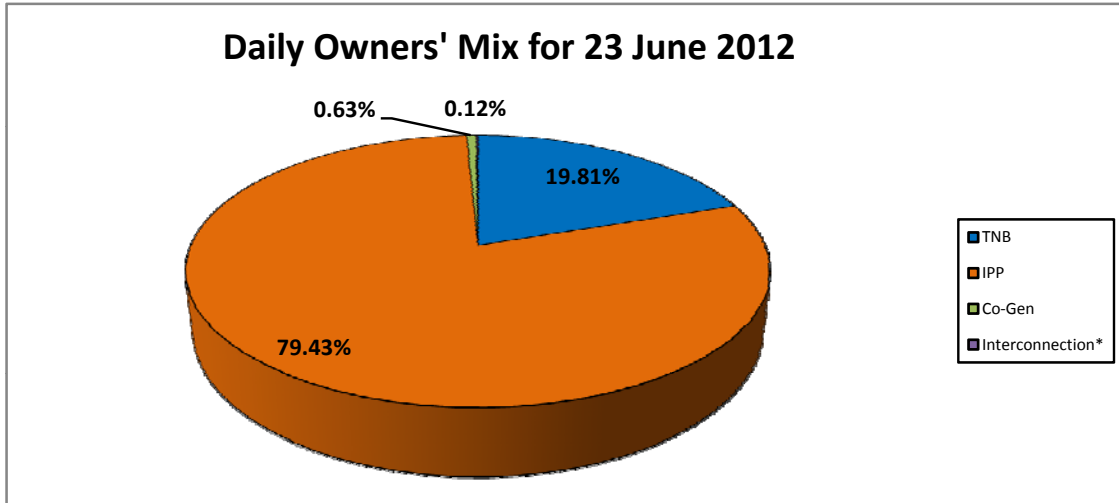

Daily Generation Mix for 23 June 2012

ST-Coal	141,316 MWh
ST-Oil	11,146 MWh
ST-Gas	- MWh
Gas	113,152 MWh
Hydro	14,645 MWh
Distillate	20,661 MWh
Co-Gen	1,913 MWh
SPORE*	(359) MWh
EGAT*	724 MWh

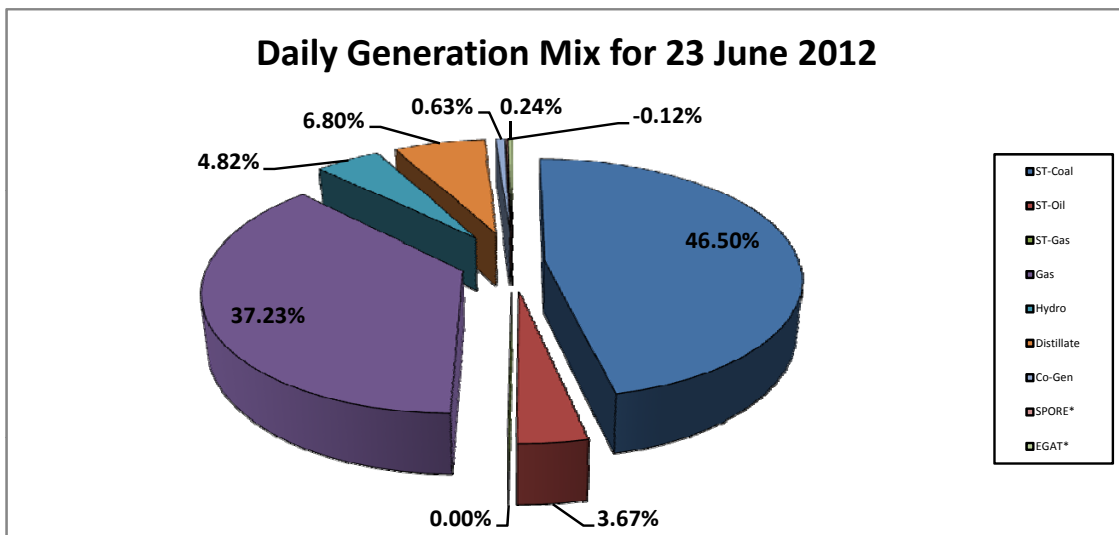

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand