


GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 25 June 2012	15,681 MW	15,741 MW	0.38%	
Energy Demand for 25 June 2012	323.43 GWh	322.65 GWh	-0.24%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:
Electricity Market Operations
Electricity Supply & Market Regulations Dept.
Energy Commission Malaysia
26-Jun-12


Daily Owners' Mix for 25 June 2012

TNB	74,327 MWh
IPP	145,835 MWh
Co-Gen	2,018 MWh
Interconnection*	(456) MWh

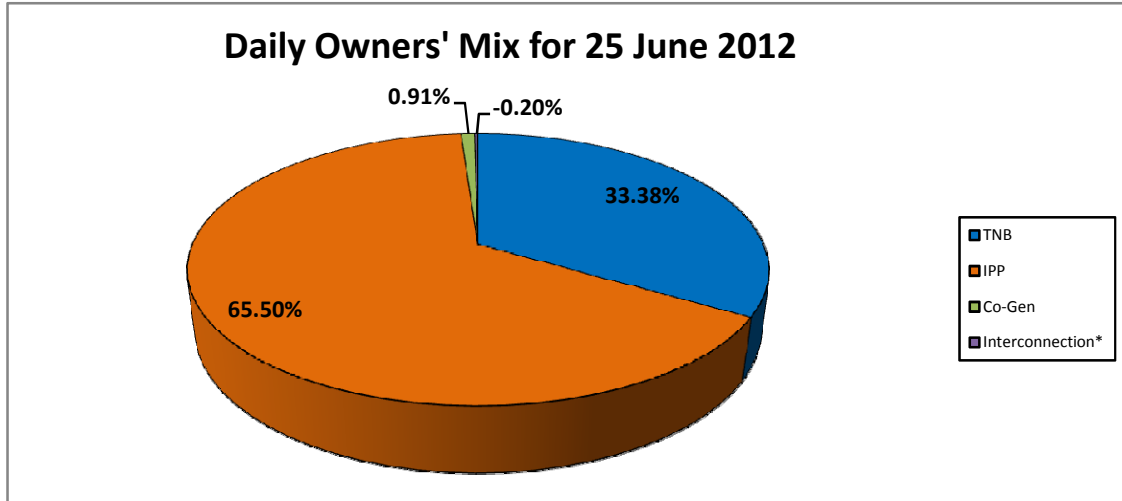

Daily Generation Mix for 25 June 2012

ST-Coal	142,825 MWh
ST-Oil	13,235 MWh
ST-Gas	- MWh
Gas	119,849 MWh
Hydro	14,930 MWh
Distillate	29,323 MWh
Co-Gen	2,018 MWh
SPORE*	131 MWh
EGAT*	(587) MWh

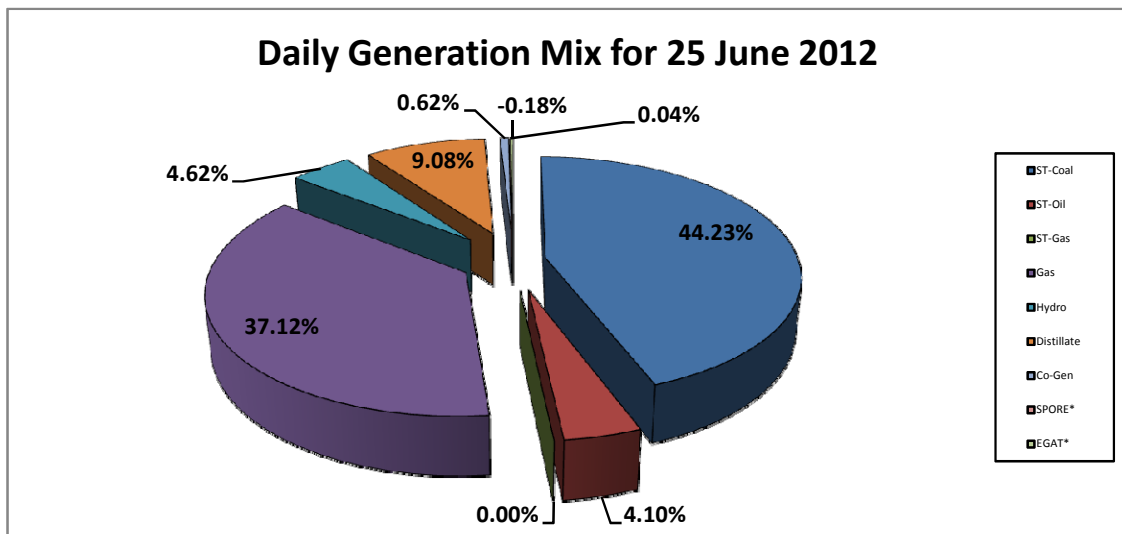

*Negative = energy is imported from Singapore and Thailand