


GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 28 June 2012	15,102 MW	15,195 MW	0.62%	
Energy Demand for 28 June 2012	315.34 GWh	313.46 GWh	-0.60%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:
Electricity Market Operations
Electricity Supply & Market Regulations Dept.
Energy Commission Malaysia
29-Jun-12


Daily Owners' Mix for 28 June 2012

TNB	77,724 MWh
IPP	233,048 MWh
Co-Gen	1,986 MWh
Interconnection*	(702) MWh

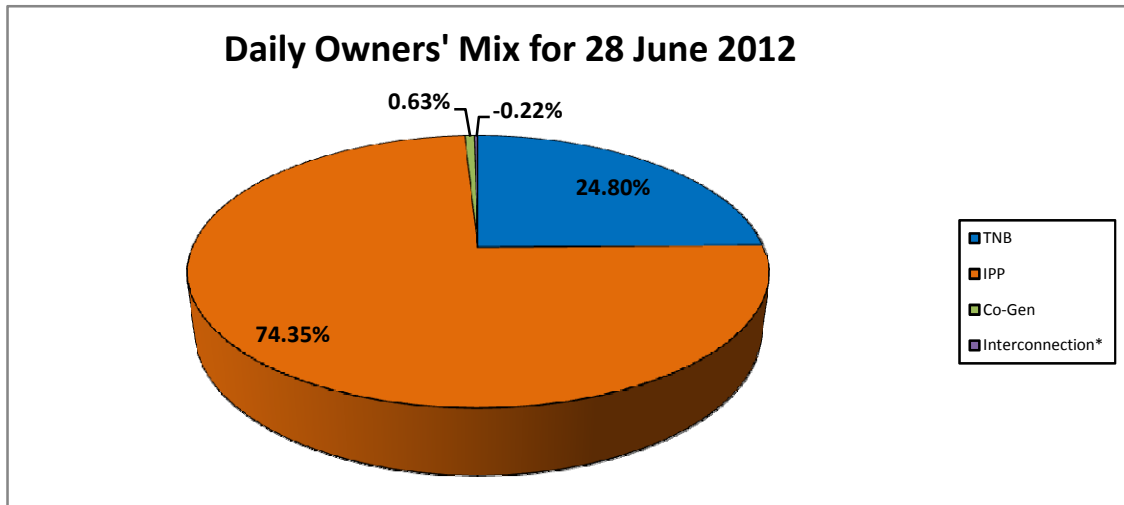

Daily Generation Mix for 28 June 2012

ST-Coal	130,433 MWh
ST-Oil	13,312 MWh
ST-Gas	- MWh
Gas	110,531 MWh
Hydro	15,229 MWh
Distillate	41,267 MWh
Co-Gen	1,986 MWh
SPORE*	(5) MWh
EGAT*	(697) MWh

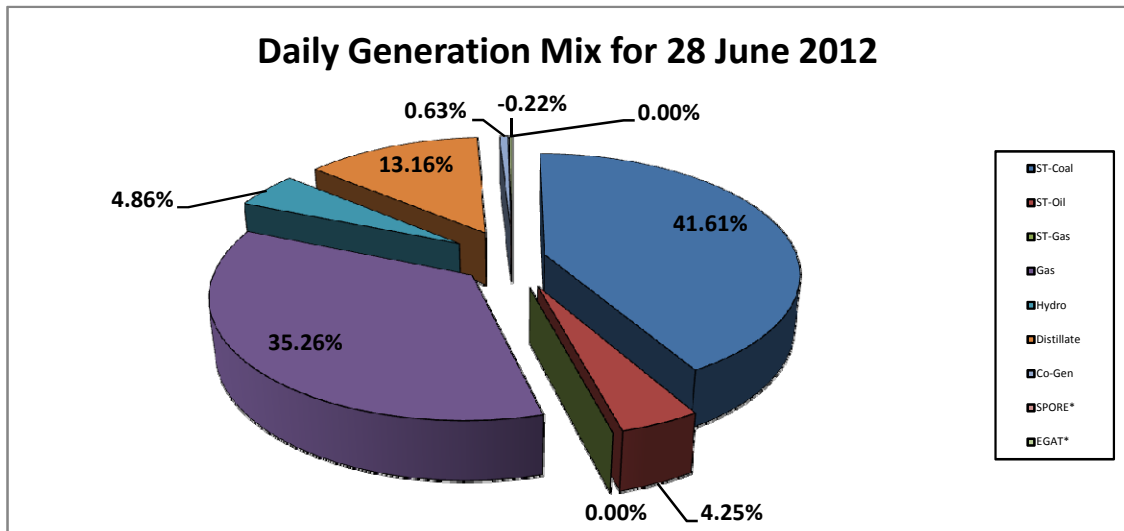

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand