

## GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 3 July 2012	14,993 MW	15,136 MW	0.95%	
Energy Demand for 3 July 2012	310.86 GWh	310.87 GWh	0.00%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

04-Jul-12


**Daily Owners' Mix for 3 July 2012**

TNB	84,839 MWh
IPP	226,999 MWh
Co-Gen	1,298 MWh
Interconnection*	262 MWh

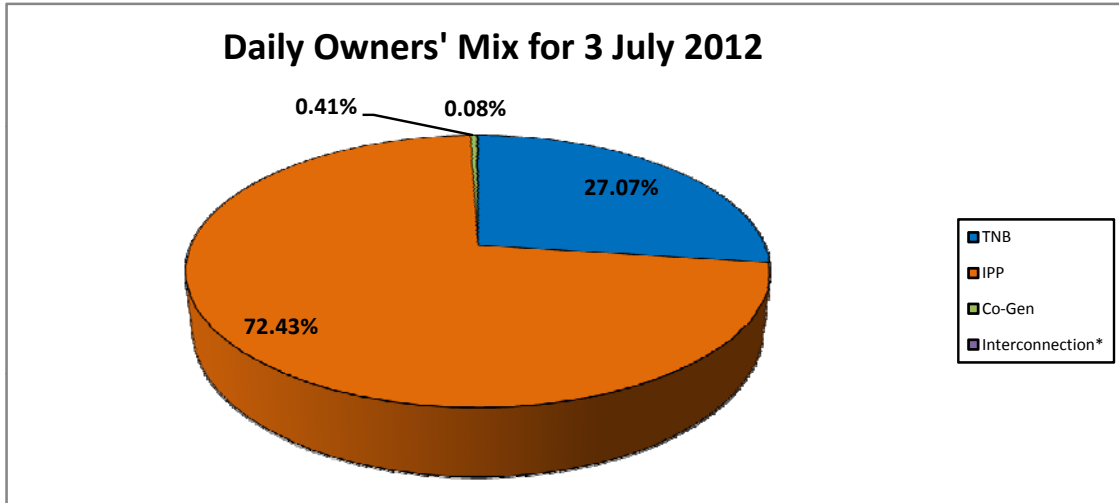

**Daily Generation Mix for 3 July 2012**

ST-Coal	126,139 MWh
ST-Oil	12,019 MWh
ST-Gas	- MWh
Gas	135,213 MWh
Hydro	16,249 MWh
Distillate	20,218 MWh
Co-Gen	1,298 MWh
SPORE*	82 MWh
EGAT*	180 MWh

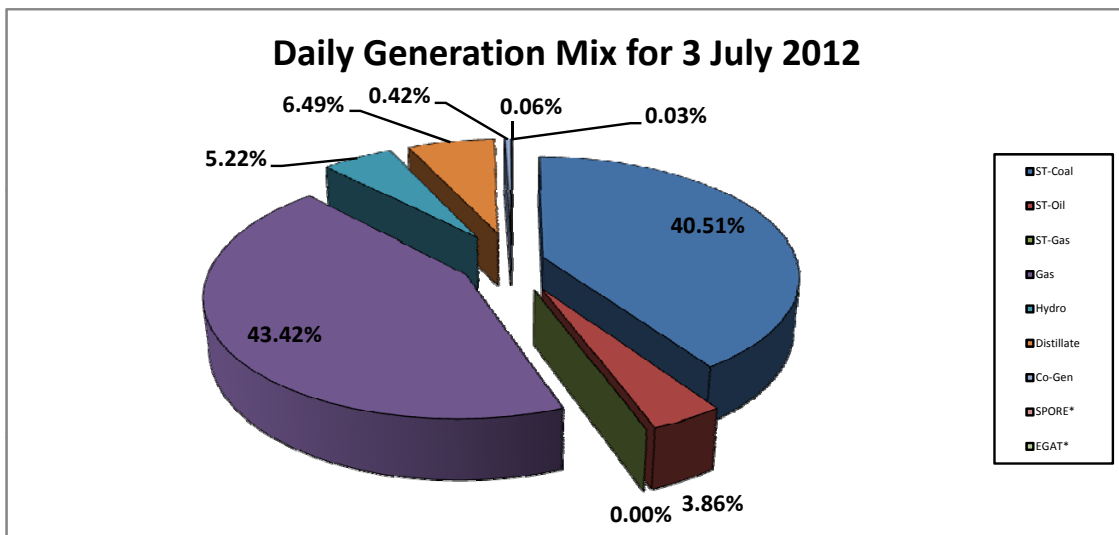

\*Negative = energy is imported from Singapore and Thailand  
 Positive = energy is exported to Singapore and Thailand