

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 7 July 2012	13,226 MW	13,149 MW	-0.58%	
Energy Demand for 7 July 2012	290.64 GWh	286.84 GWh	-1.31%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

08-Jul-12


Daily Owners' Mix for 7 July 2012

TNB	78,938 MWh
IPP	207,254 MWh
Co-Gen	1,221 MWh
Interconnection*	578 MWh

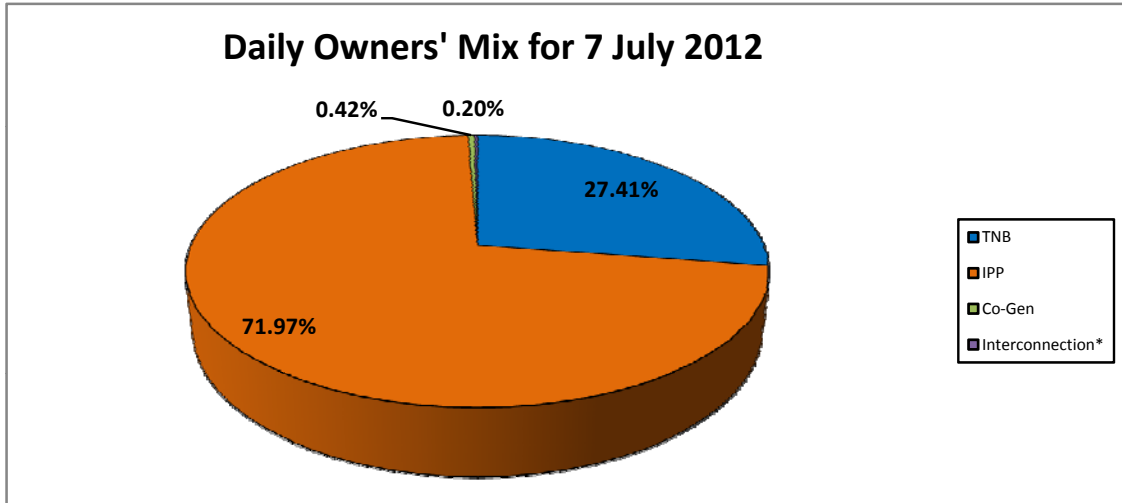

Daily Generation Mix for 7 July 2012

ST-Coal	134,307 MWh
ST-Oil	- MWh
ST-Gas	- MWh
Gas	134,943 MWh
Hydro	16,942 MWh
Distillate	- MWh
Co-Gen	1,221 MWh
SPORE*	(145) MWh
EGAT*	723 MWh

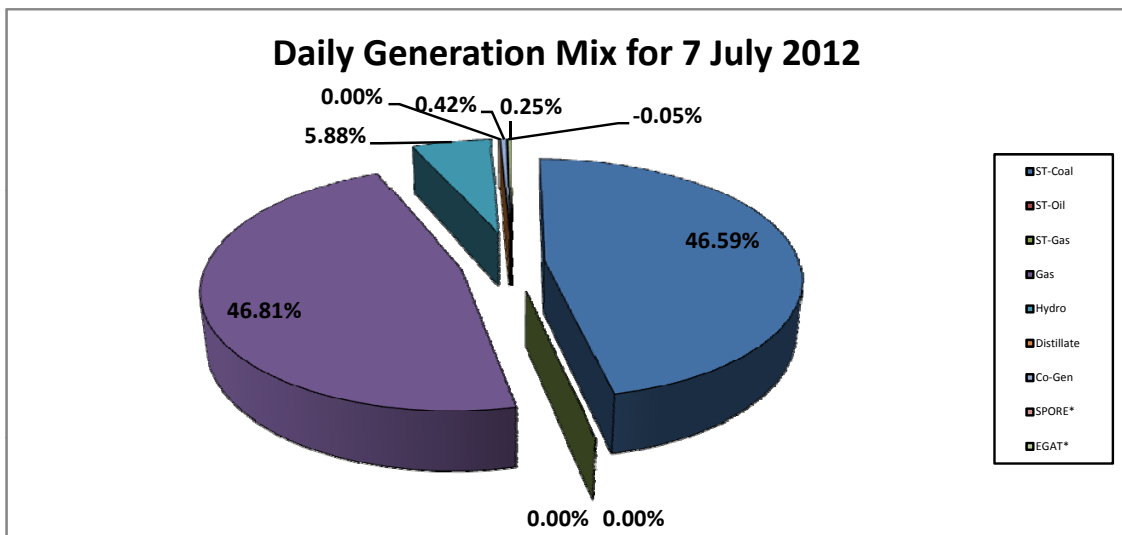

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand