

## GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 8 July 2012	12,776 MW	12,666 MW	-0.86%	
Energy Demand for 8 July 2012	271.86 GWh	267.32 GWh	-1.67%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

09-Jul-12


**Daily Owners' Mix for 8 July 2012**

TNB	73,934 MWh
IPP	192,520 MWh
Co-Gen	1,237 MWh
Interconnection*	370 MWh

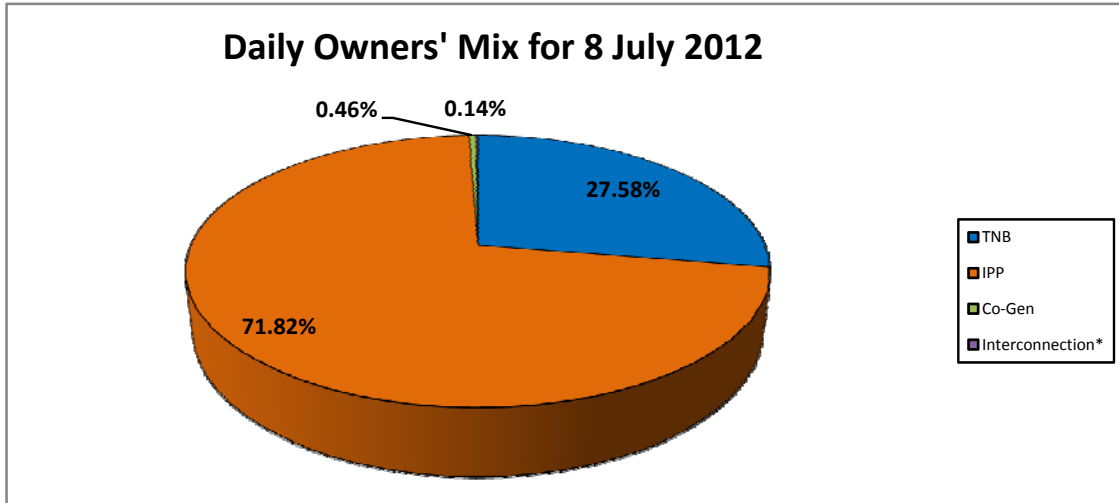

**Daily Generation Mix for 8 July 2012**

ST-Coal	132,884 MWh
ST-Oil	- MWh
ST-Gas	- MWh
Gas	107,348 MWh
Hydro	16,371 MWh
Distillate	9,851 MWh
Co-Gen	1,237 MWh
SPORE*	(328) MWh
EGAT*	698 MWh

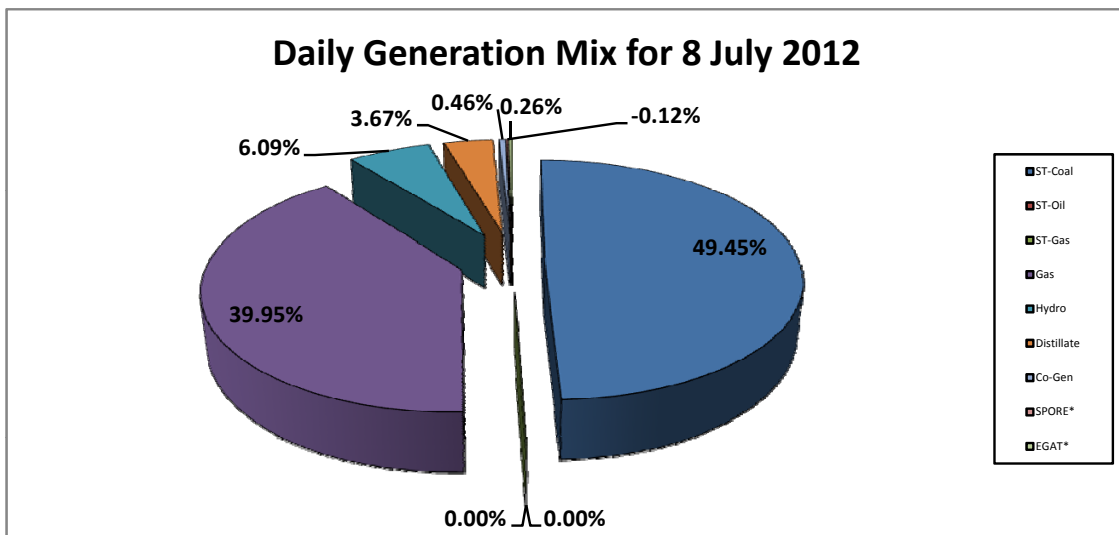

\*Negative = energy is imported from Singapore and Thailand  
 Positive = energy is exported to Singapore and Thailand