

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 9 July 2012	14,840 MW	14,836 MW	-0.03%	
Energy Demand for 9 July 2012	306.98 GWh	304.85 GWh	-0.69%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

10-Jul-12


Daily Owners' Mix for 9 July 2012

TNB	88,683 MWh
IPP	213,994 MWh
Co-Gen	1,322 MWh
Interconnection*	(847) MWh

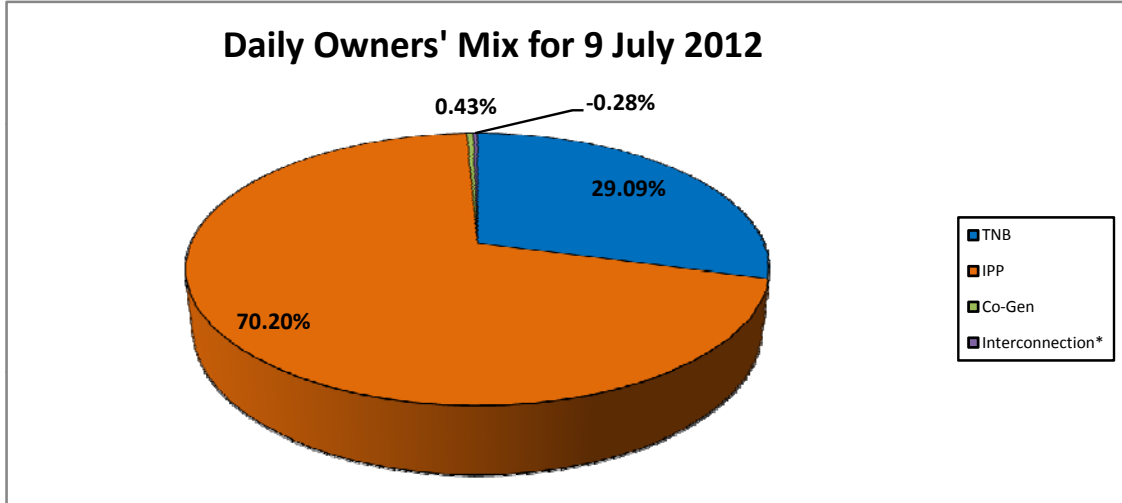

Daily Generation Mix for 9 July 2012

ST-Coal	131,246 MWh
ST-Oil	- MWh
ST-Gas	- MWh
Gas	106,079 MWh
Hydro	18,939 MWh
Distillate	46,413 MWh
Co-Gen	1,322 MWh
SPORE*	(238) MWh
EGAT*	(609) MWh

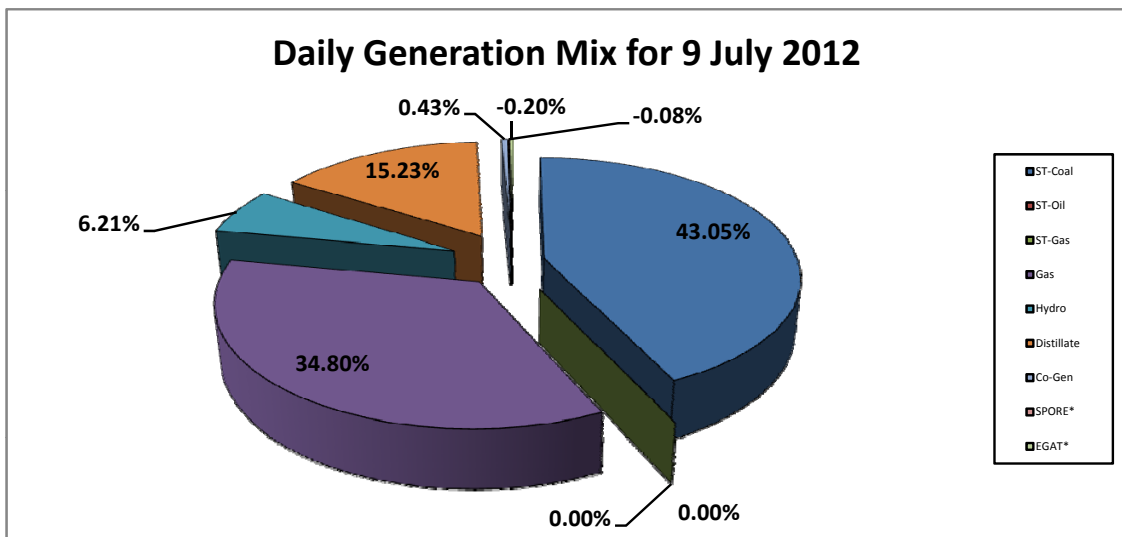

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand