

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 13 July 2012	15,005 MW	14,899 MW	-0.71%	
Energy Demand for 13 July 2012	314.31 GWh	313.94 GWh	-0.12%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

14-Jul-12


Daily Owners' Mix for 13 July 2012

TNB	82,706 MWh
IPP	229,178 MWh
Co-Gen	1,277 MWh
Interconnection*	(778) MWh

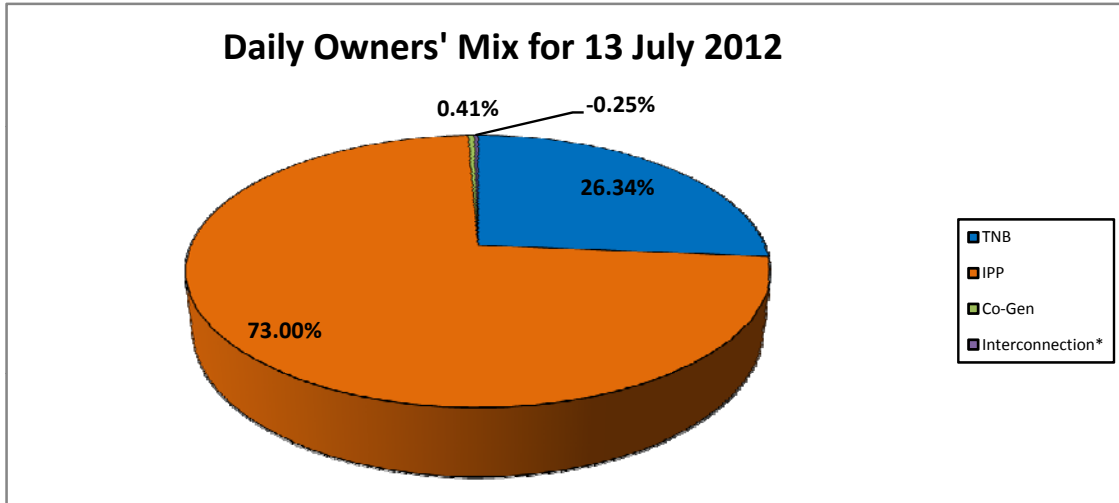

Daily Generation Mix for 13 July 2012

ST-Coal	116,789 MWh
ST-Oil	13,387 MWh
ST-Gas	- MWh
Gas	111,214 MWh
Hydro	15,223 MWh
Distillate	55,271 MWh
Co-Gen	1,277 MWh
SPORE*	(76) MWh
EGAT*	(702) MWh

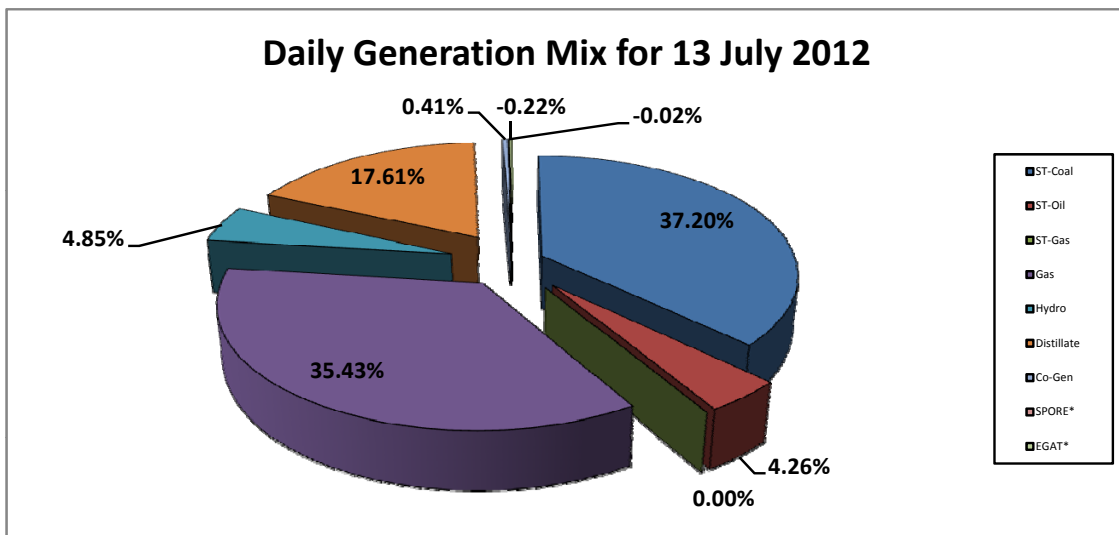

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand