

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 26 July 2012	15,306 MW	15,358 MW	0.34%	
Energy Demand for 26 July 2012	318.97 GWh	321.06 GWh	0.66%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

27-Jul-12


Daily Owners' Mix for 26 July 2012

TNB	71,824 MWh
IPP	247,259 MWh
Co-Gen	1,260 MWh
Interconnection*	(719) MWh

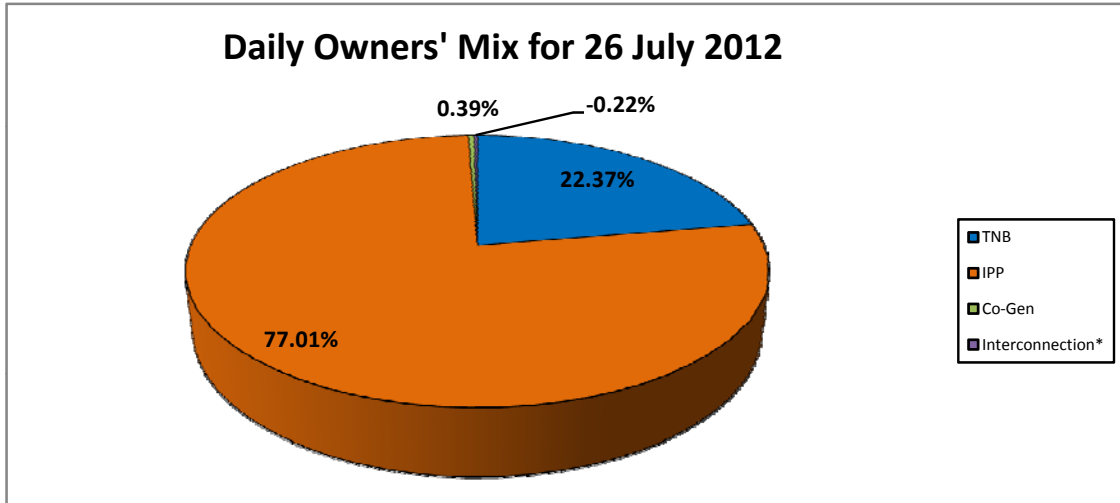

Daily Generation Mix for 26 July 2012

ST-Coal	134,503 MWh
ST-Oil	12,922 MWh
ST-Gas	- MWh
Gas	157,467 MWh
Hydro	14,191 MWh
Distillate	- MWh
Co-Gen	1,260 MWh
SPORE*	(20) MWh
EGAT*	(699) MWh

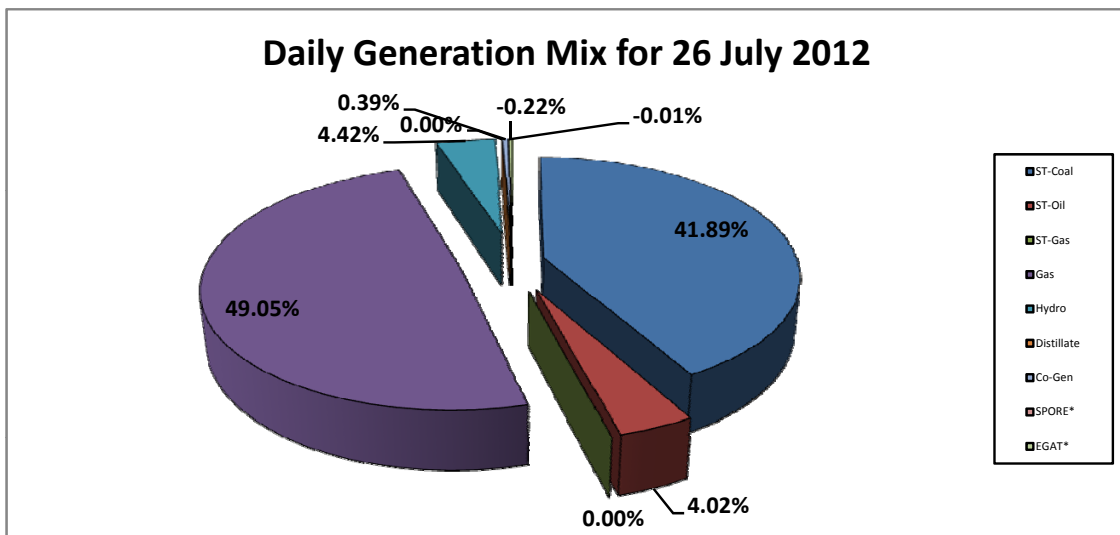

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand