

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 27 July 2012	15,113 MW	15,214 MW	0.67%	
Energy Demand for 27 July 2012	319.93 GWh	319.56 GWh	-0.12%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

28-Jul-12


Daily Owners' Mix for 27 July 2012

TNB	72,260 MWh
IPP	245,477 MWh
Co-Gen	1,287 MWh
Interconnection*	(539) MWh

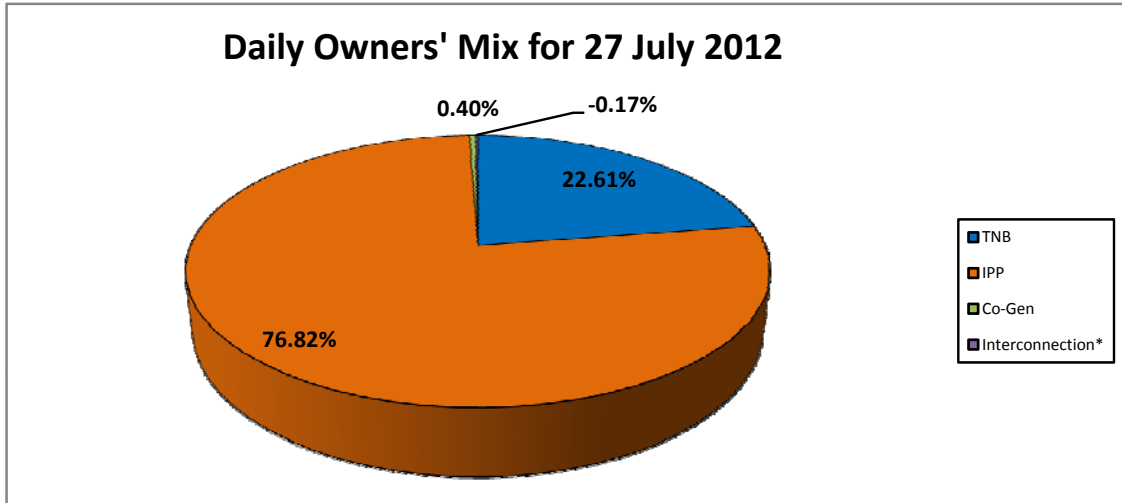

Daily Generation Mix for 27 July 2012

ST-Coal	138,025 MWh
ST-Oil	13,345 MWh
ST-Gas	573 MWh
Gas	151,387 MWh
Hydro	14,407 MWh
Distillate	- MWh
Co-Gen	1,287 MWh
SPORE*	157 MWh
EGAT*	(696) MWh

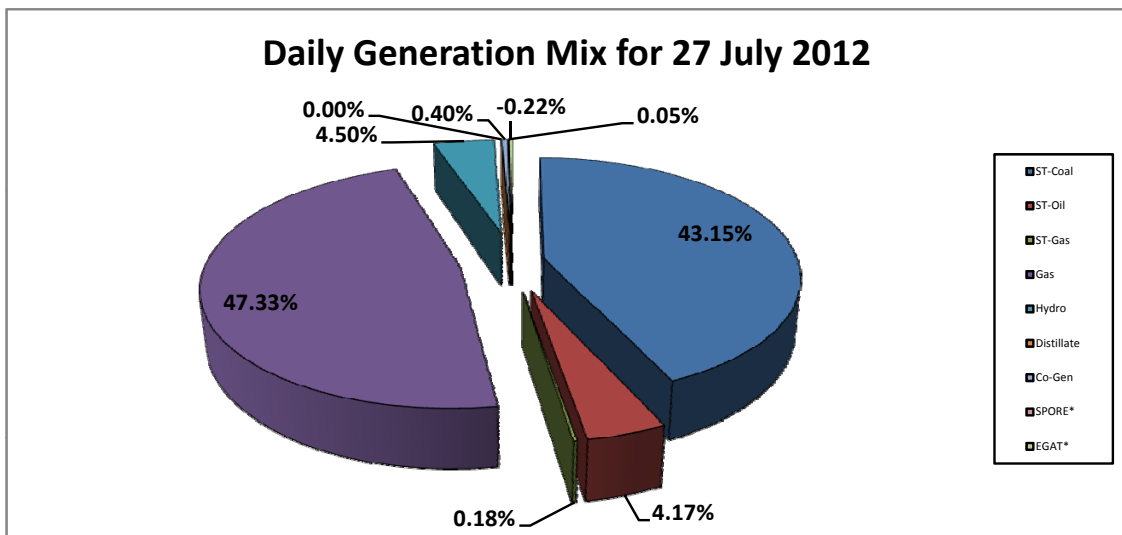

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand