

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 28 July 2012	13,293 MW	13,180 MW	-0.85%	
Energy Demand for 28 July 2012	295.66 GWh	294.59 GWh	-0.36%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

29-Jul-12


Daily Owners' Mix for 28 July 2012

TNB	50,322 MWh
IPP	242,280 MWh
Co-Gen	1,217 MWh
Interconnection*	(771) MWh

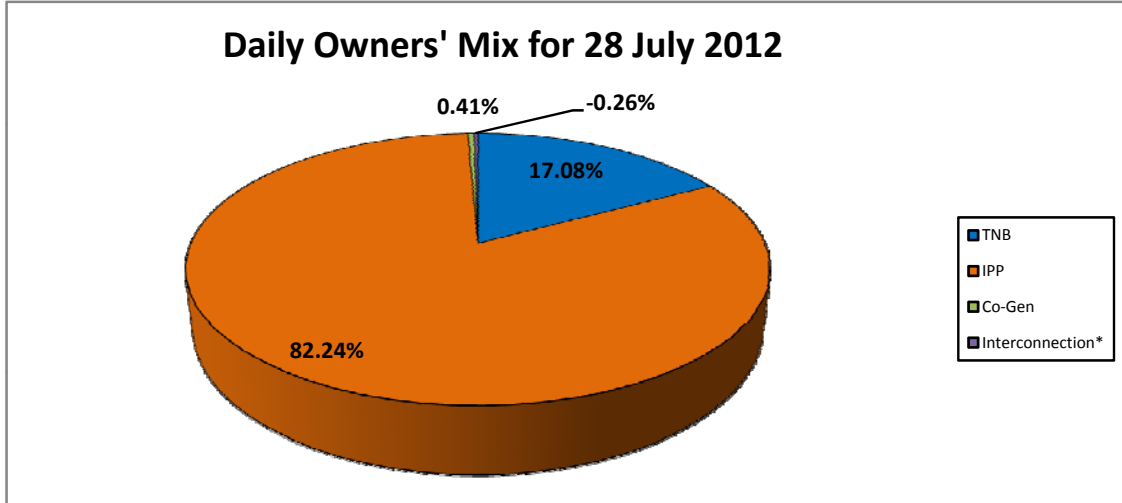

Daily Generation Mix for 28 July 2012

ST-Coal	150,920 MWh
ST-Oil	13,015 MWh
ST-Gas	- MWh
Gas	121,515 MWh
Hydro	7,152 MWh
Distillate	- MWh
Co-Gen	1,217 MWh
SPORE*	(73) MWh
EGAT*	(698) MWh

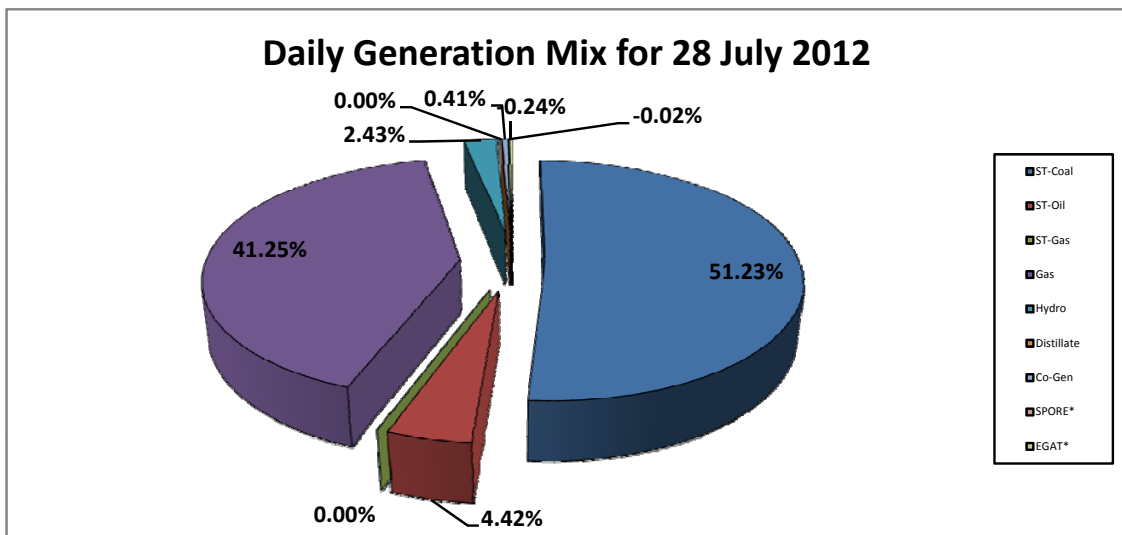

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand