

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 2 August 2012	14,986 MW	14,895 MW	-0.61%	
Energy Demand for 2 August 2012	316.65 GWh	314.38 GWh	-0.72%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

03-Aug-12


Daily Owners' Mix for 2 August 2012

TNB	65,941 MWh
IPP	247,605 MWh
Co-Gen	1,339 MWh
Interconnection*	509 MWh

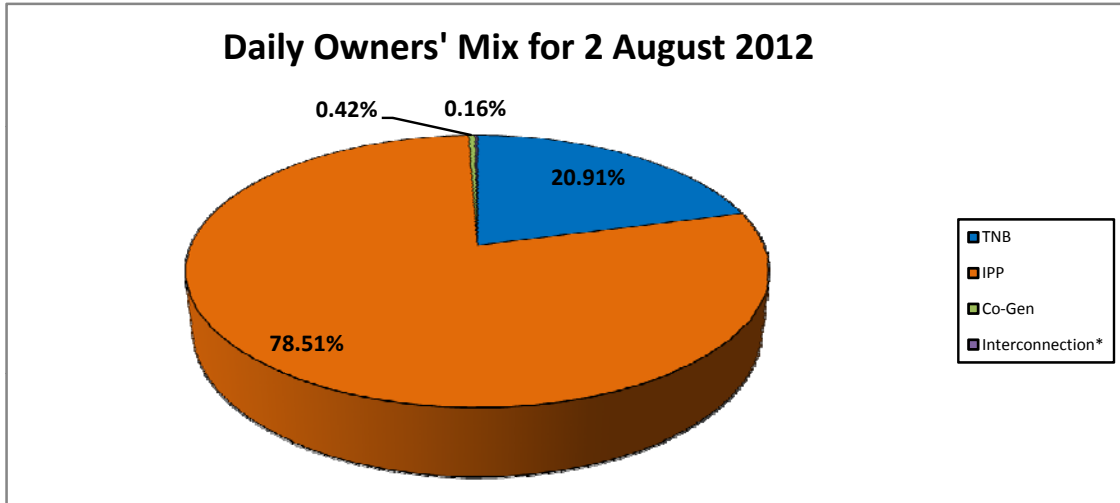

Daily Generation Mix for 2 August 2012

ST-Coal	137,037 MWh
ST-Oil	14,717 MWh
ST-Gas	- MWh
Gas	120,030 MWh
Hydro	11,161 MWh
Distillate	30,601 MWh
Co-Gen	1,339 MWh
SPORE*	(223) MWh
EGAT*	732 MWh

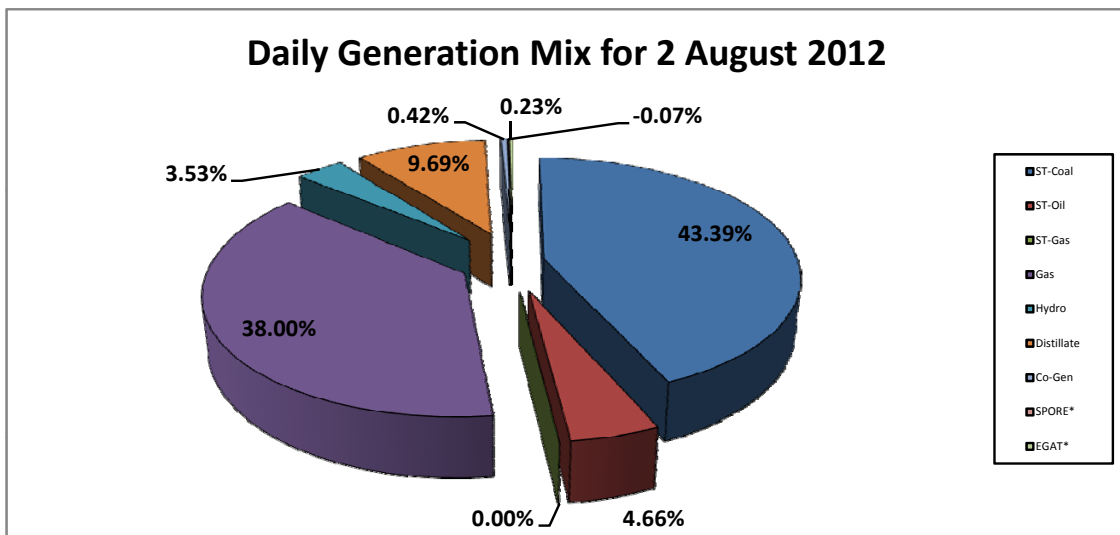

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand