

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 4 August 2012	12,954 MW	13,013 MW	0.46%	
Energy Demand for 4 August 2012	289.76 GWh	288.69 GWh	-0.37%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

05-Aug-12


Daily Owners' Mix for 4 August 2012

TNB	58,919 MWh
IPP	228,944 MWh
Co-Gen	1,552 MWh
Interconnection*	728 MWh

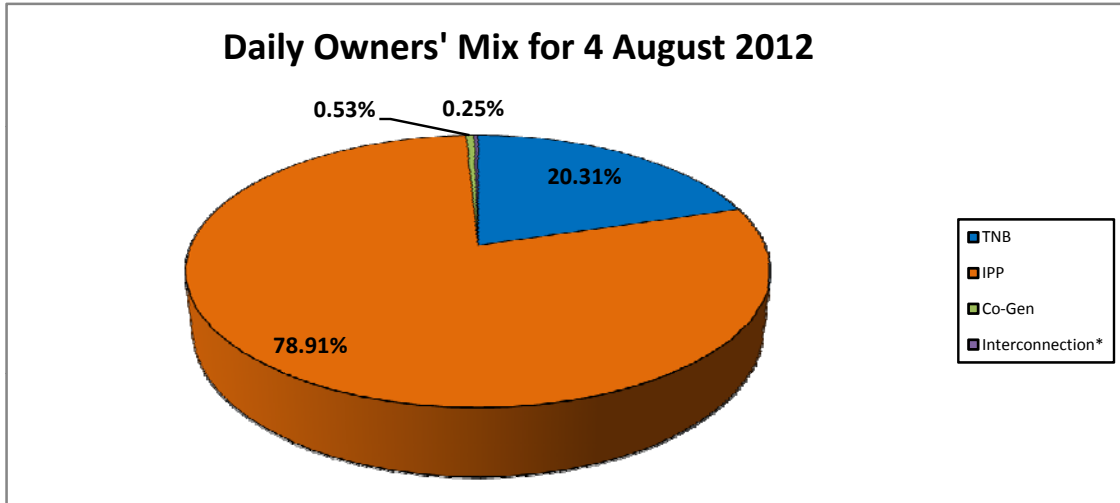

Daily Generation Mix for 4 August 2012

ST-Coal	149,215 MWh
ST-Oil	- MWh
ST-Gas	- MWh
Gas	131,925 MWh
Hydro	6,723 MWh
Distillate	- MWh
Co-Gen	1,552 MWh
SPORE*	(7) MWh
EGAT*	735 MWh

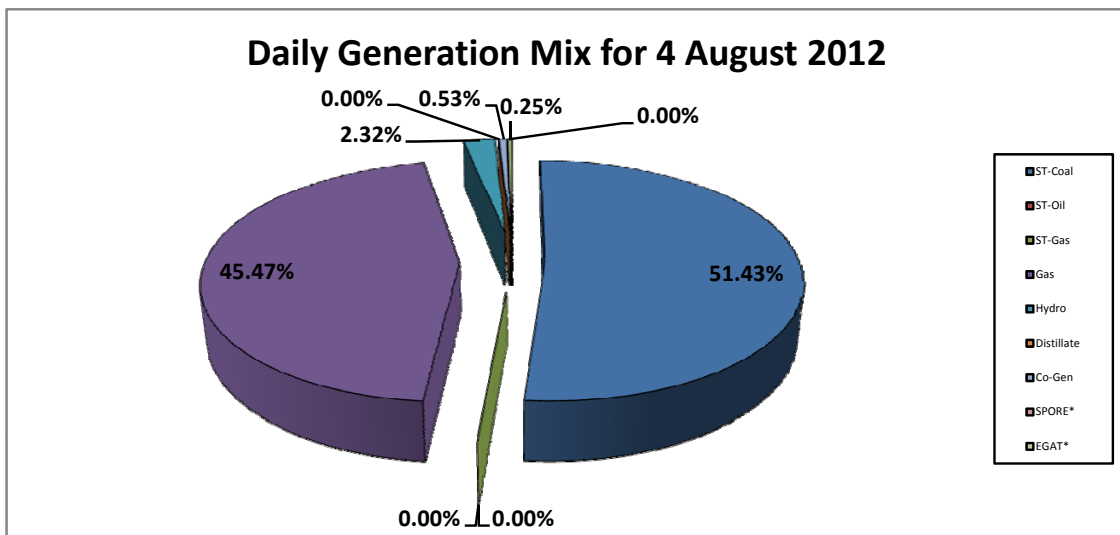

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand