

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 7 August 2012	14,936 MW	15,046 MW	0.74%	
Energy Demand for 7 August 2012	310.04 GWh	309.23 GWh	-0.26%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

08-Aug-12


Daily Owners' Mix for 7 August 2012

TNB	61,686 MWh
IPP	245,130 MWh
Co-Gen	1,964 MWh
Interconnection*	(449) MWh

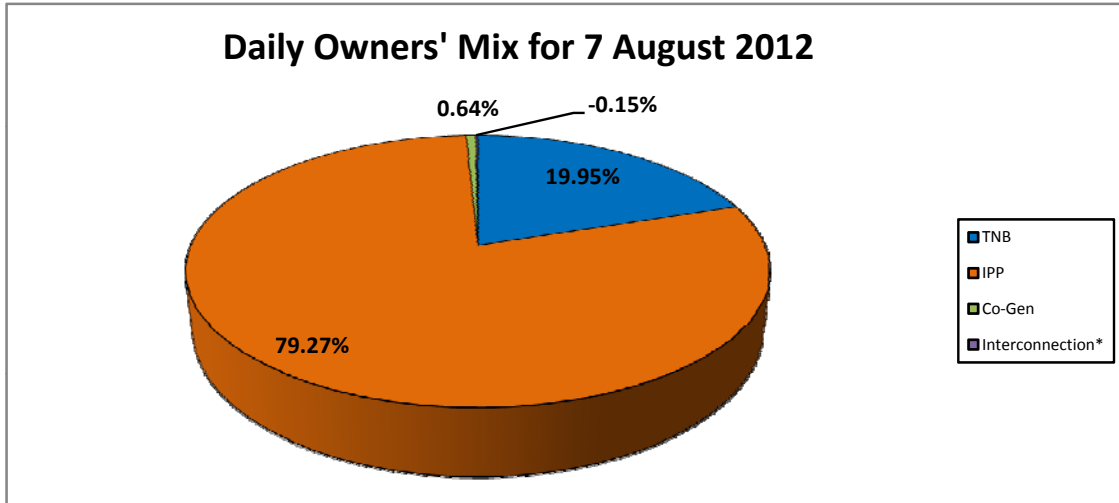

Daily Generation Mix for 7 August 2012

ST-Coal	139,701 MWh
ST-Oil	3,698 MWh
ST-Gas	- MWh
Gas	151,265 MWh
Hydro	12,152 MWh
Distillate	- MWh
Co-Gen	1,964 MWh
SPORE*	250 MWh
EGAT*	(699) MWh

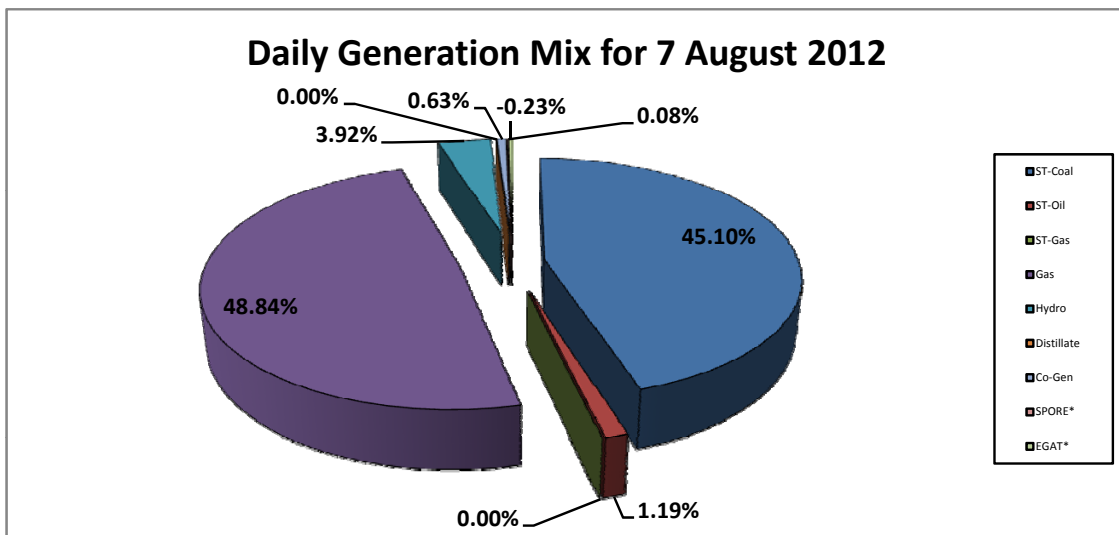

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand