

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 9 August 2012	15,196 MW	15,190 MW	-0.04%	
Energy Demand for 9 August 2012	318.28 GWh	318.20 GWh	-0.03%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

10-Aug-12


Daily Owners' Mix for 9 August 2012

TNB	69,428 MWh
IPP	246,133 MWh
Co-Gen	1,843 MWh
Interconnection*	(794) MWh

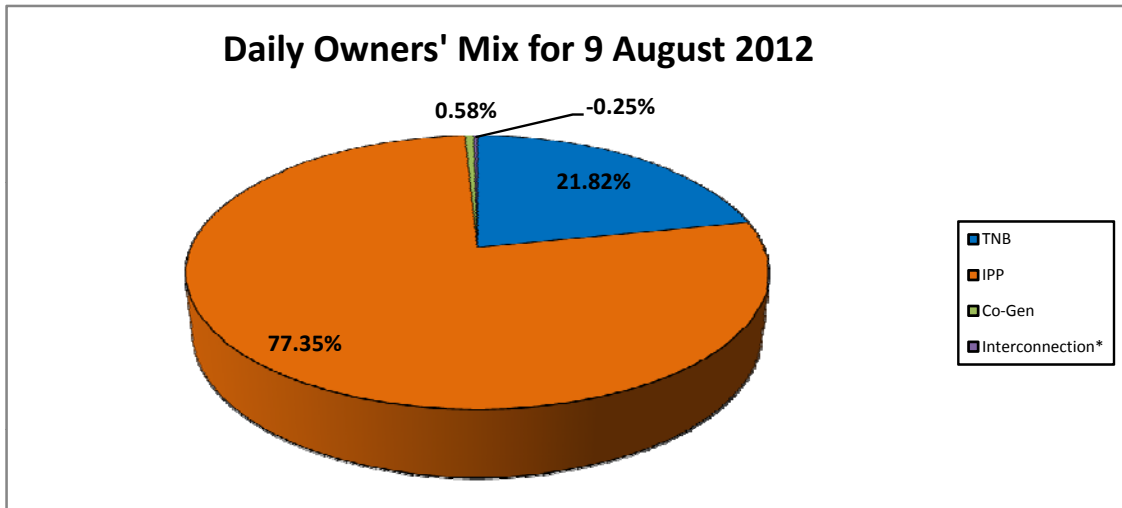

Daily Generation Mix for 9 August 2012

ST-Coal	140,309 MWh
ST-Oil	245 MWh
ST-Gas	- MWh
Gas	160,999 MWh
Hydro	14,008 MWh
Distillate	- MWh
Co-Gen	1,843 MWh
SPORE*	(96) MWh
EGAT*	(698) MWh

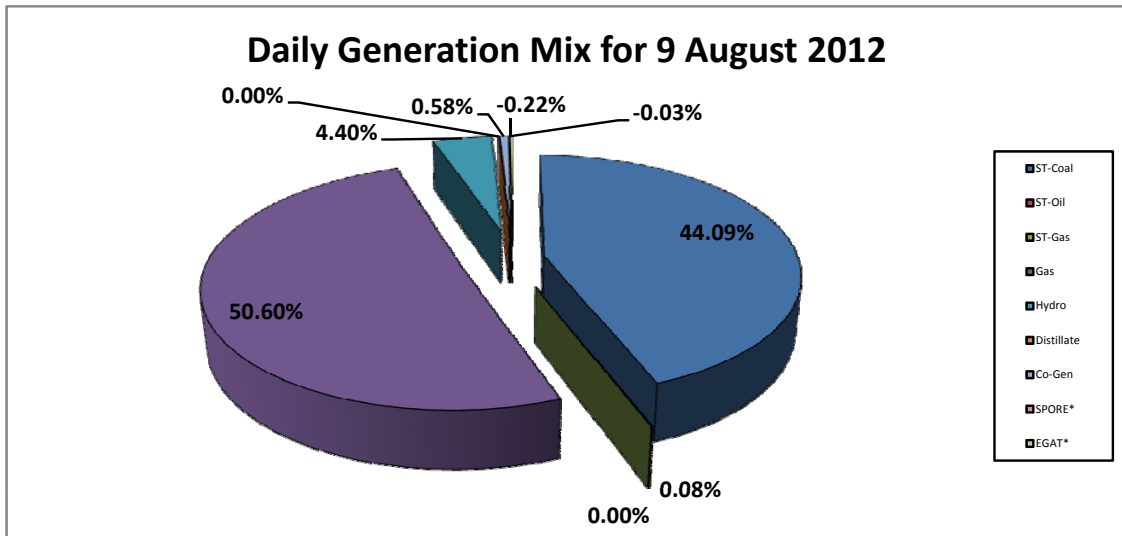

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand