


GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 12 August 2012	12,827 MW	13,124 MW	2.32%	
Energy Demand for 12 August 2012	274.22 GWh	282.24 GWh	2.92%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:
Electricity Market Operations
Electricity Supply & Market Regulations Dept.
Energy Commission Malaysia
13-Aug-12


Daily Owners' Mix for 12 August 2012

TNB	52,712 MWh
IPP	226,626 MWh
Co-Gen	1,957 MWh
Interconnection*	(945) MWh

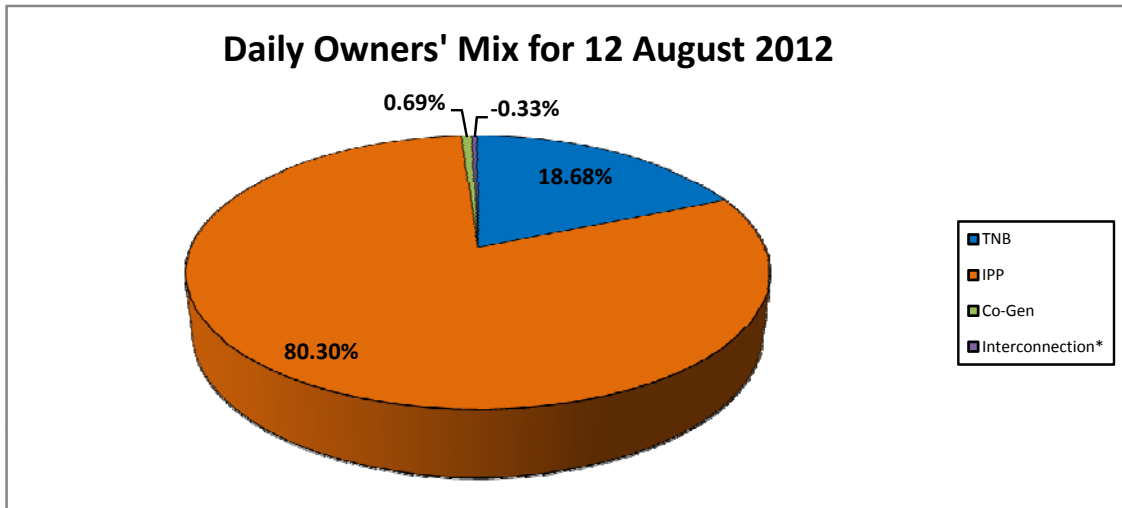

Daily Generation Mix for 12 August 2012

ST-Coal	149,992 MWh
ST-Oil	- MWh
ST-Gas	- MWh
Gas	121,498 MWh
Hydro	7,848 MWh
Distillate	- MWh
Co-Gen	1,957 MWh
SPORE*	(240) MWh
EGAT*	(705) MWh

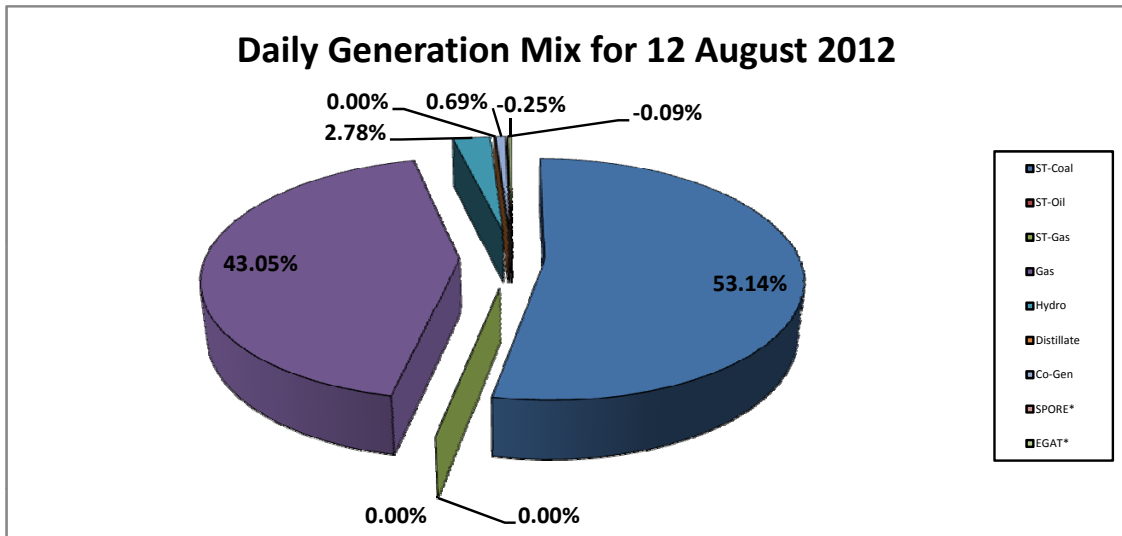

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand