

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 14 August 2012	15,084 MW	15,528 MW	2.94%	
Energy Demand for 14 August 2012	320.94 GWh	325.18 GWh	1.32%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

15-Aug-12


Daily Owners' Mix for 14 August 2012

TNB	76,960 MWh
IPP	246,819 MWh
Co-Gen	1,968 MWh
Interconnection*	571 MWh

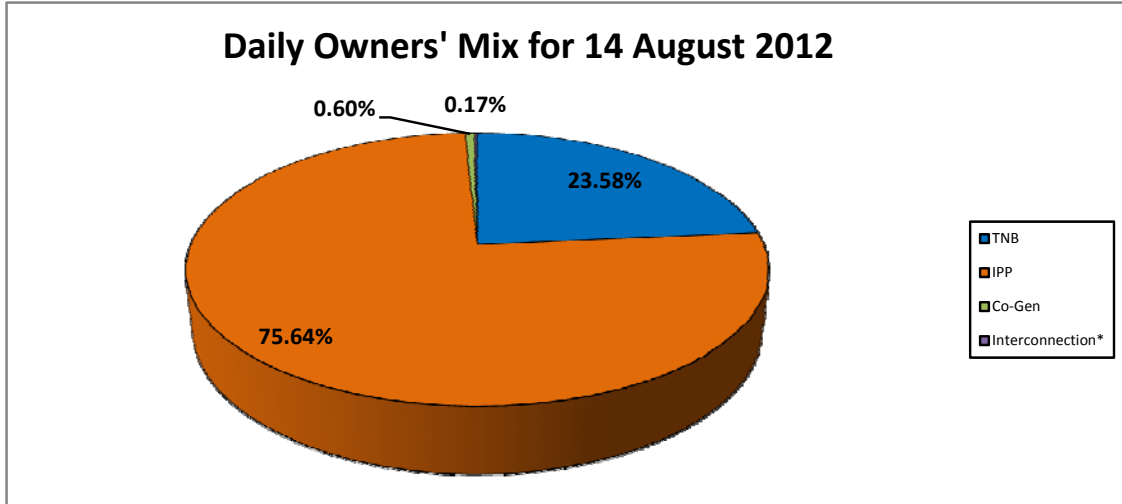

Daily Generation Mix for 14 August 2012

ST-Coal	137,698 MWh
ST-Oil	- MWh
ST-Gas	164 MWh
Gas	171,106 MWh
Hydro	14,975 MWh
Distillate	- MWh
Co-Gen	1,968 MWh
SPORE*	(159) MWh
EGAT*	730 MWh

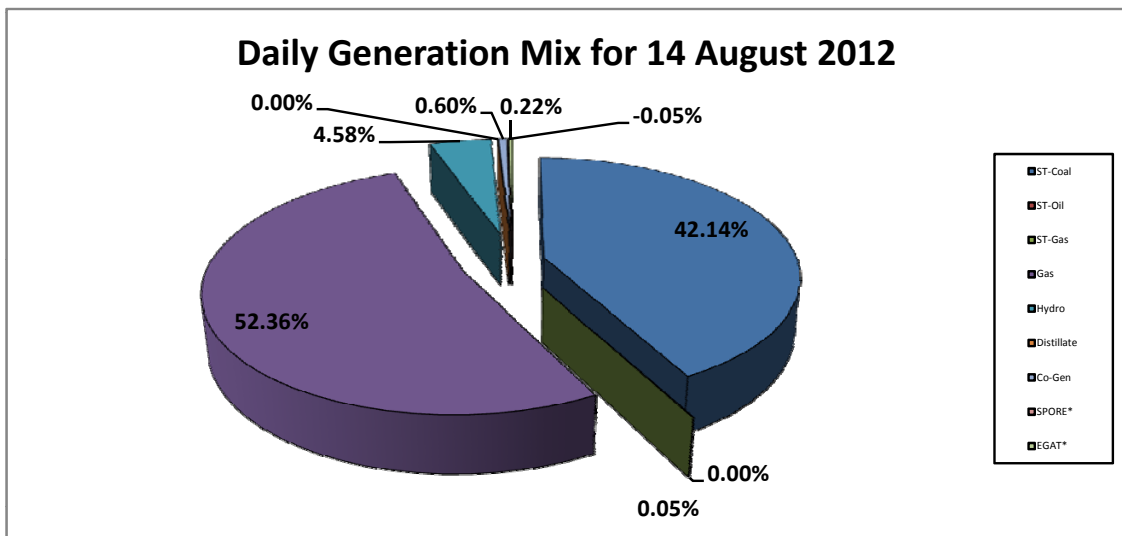

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand