

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 17 August 2012	13,622 MW	13,819 MW	1.45%	
Energy Demand for 17 August 2012	294.54 GWh	296.87 GWh	0.79%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

18-Aug-12


Daily Owners' Mix for 17 August 2012

TNB	59,902	MWh
IPP	235,680	MWh
Co-Gen	2,317	MWh
Interconnection*	1,027	MWh

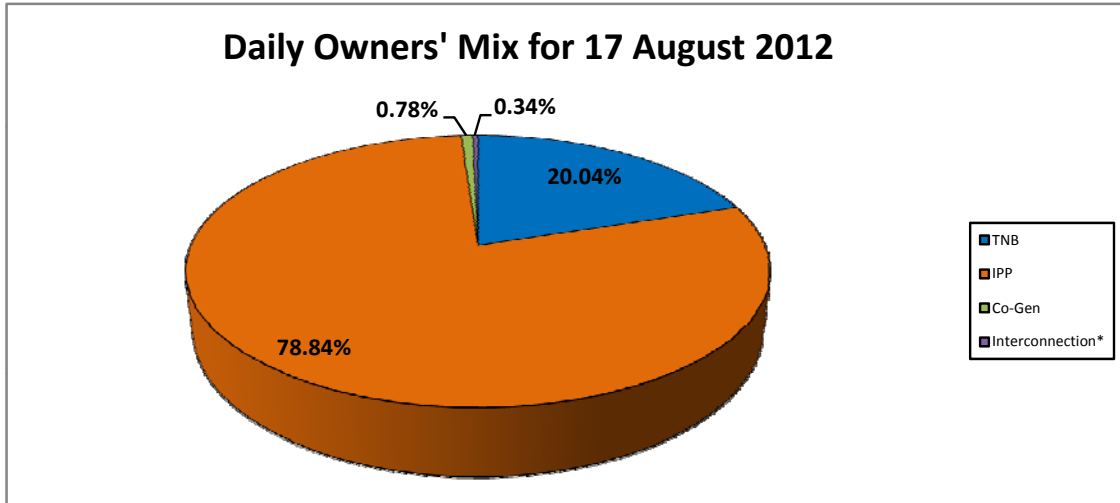

Daily Generation Mix for 17 August 2012

ST-Coal	146,106	MWh
ST-Oil	-	MWh
ST-Gas	-	MWh
Gas	137,619	MWh
Hydro	11,857	MWh
Distillate	-	MWh
Co-Gen	2,317	MWh
SPORE*	324	MWh
EGAT*	703	MWh

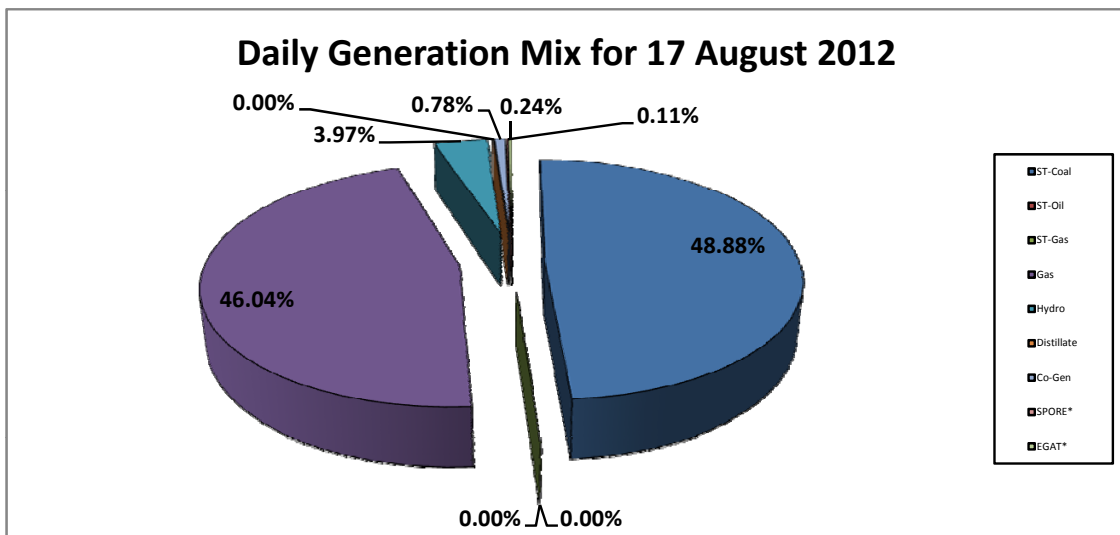

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand