

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 20 August 2012	10,066 MW	10,210 MW	1.43%	
Energy Demand for 20 August 2012	203.49 GWh	210.97 GWh	3.68%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

21-Aug-12


Daily Owners' Mix for 20 August 2012

TNB	57,745 MWh
IPP	150,320 MWh
Co-Gen	1,915 MWh
Interconnection*	(993) MWh

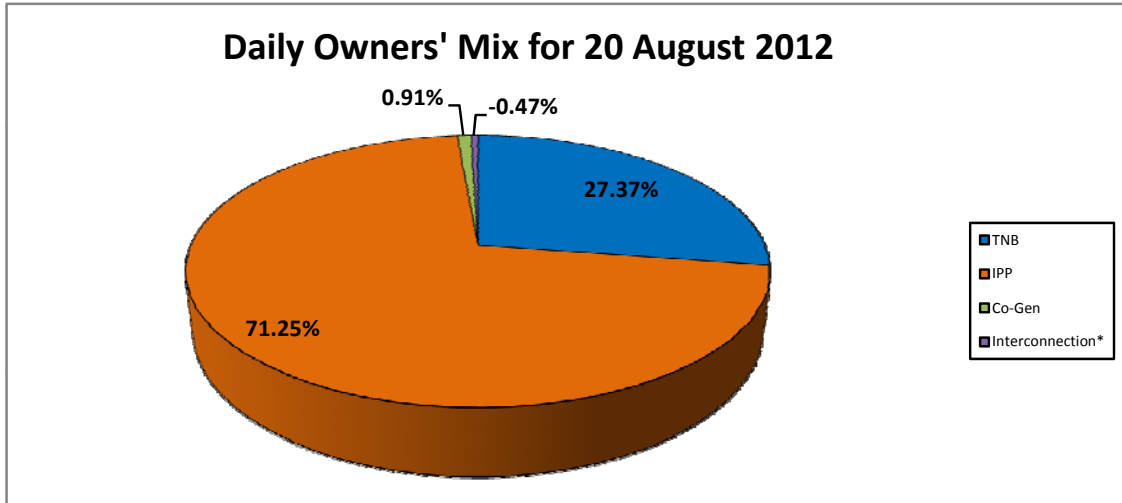

Daily Generation Mix for 20 August 2012

ST-Coal	68,603 MWh
ST-Oil	- MWh
ST-Gas	428 MWh
Gas	129,113 MWh
Hydro	9,921 MWh
Distillate	- MWh
Co-Gen	1,915 MWh
SPORE*	(384) MWh
EGAT*	(609) MWh

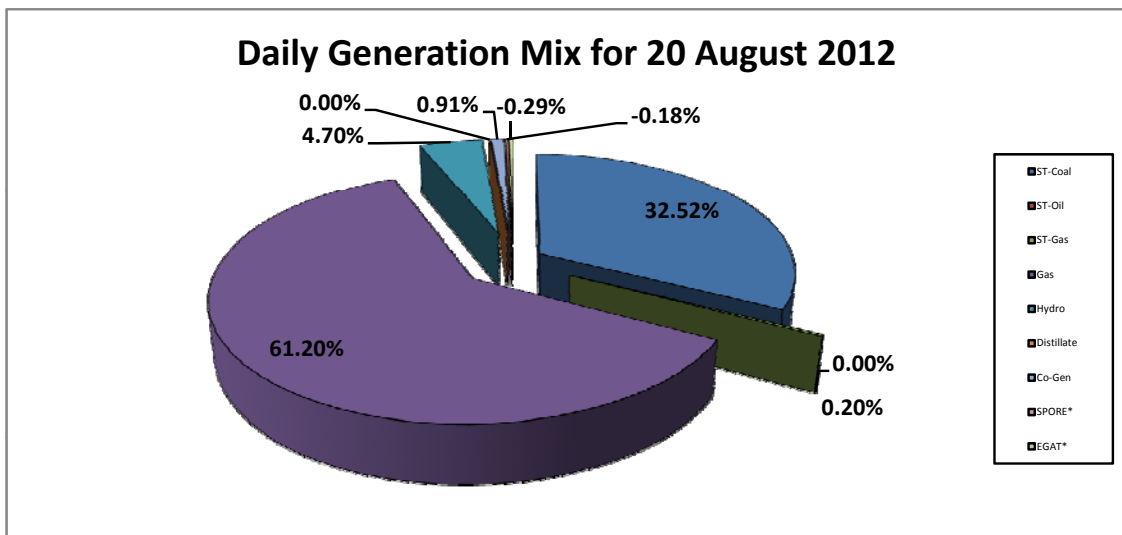

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand