

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 22 August 2012	12,494 MW	12,376 MW	-0.94%	
Energy Demand for 22 August 2012	257.70 GWh	156.99 GWh	-39.08%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

23-Aug-12


Daily Owners' Mix for 22 August 2012

TNB	54,792 MWh
IPP	199,605 MWh
Co-Gen	2,096 MWh
Interconnection*	(501) MWh

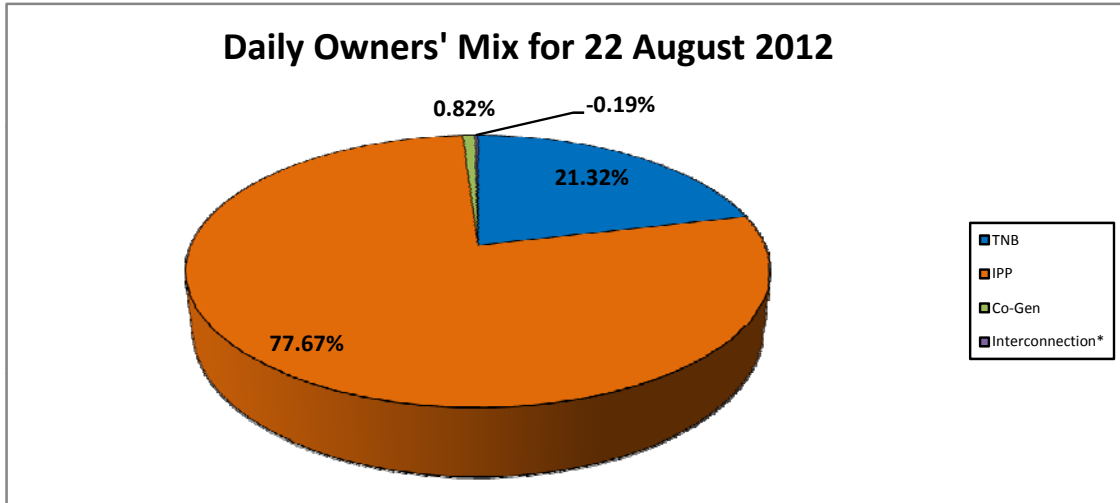

Daily Generation Mix for 22 August 2012

ST-Coal	104,545 MWh
ST-Oil	- MWh
ST-Gas	- MWh
Gas	141,801 MWh
Hydro	8,051 MWh
Distillate	- MWh
Co-Gen	2,096 MWh
SPORE*	200 MWh
EGAT*	(701) MWh

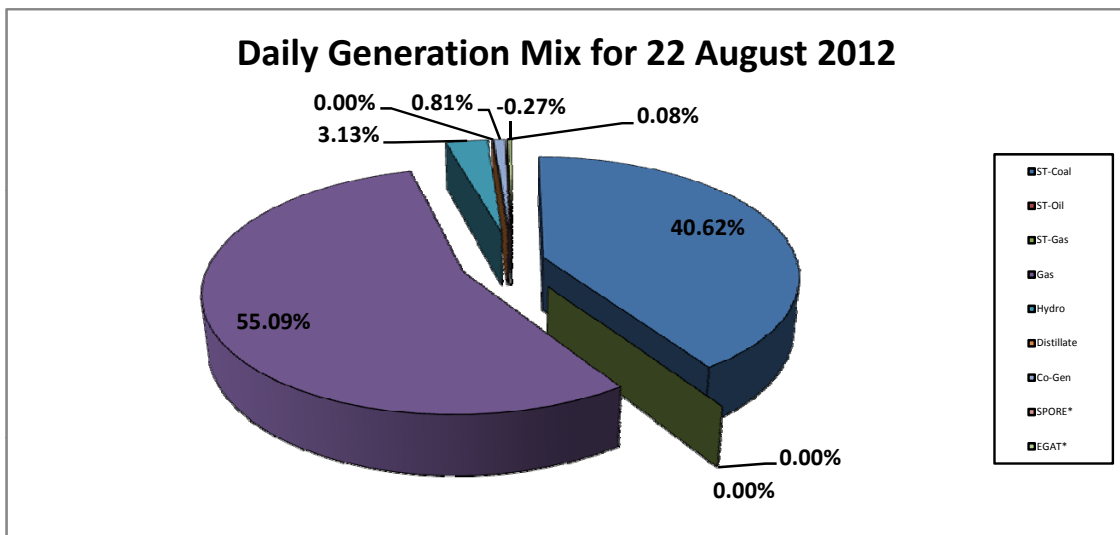

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand