

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 25 August 2012	12,373 MW	12,645 MW	2.20%	
Energy Demand for 25 August 2012	271.99 GWh	272.34 GWh	0.13%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

26-Aug-12


Daily Owners' Mix for 25 August 2012

TNB	60,433 MWh
IPP	208,844 MWh
Co-Gen	2,347 MWh
Interconnection*	(765) MWh

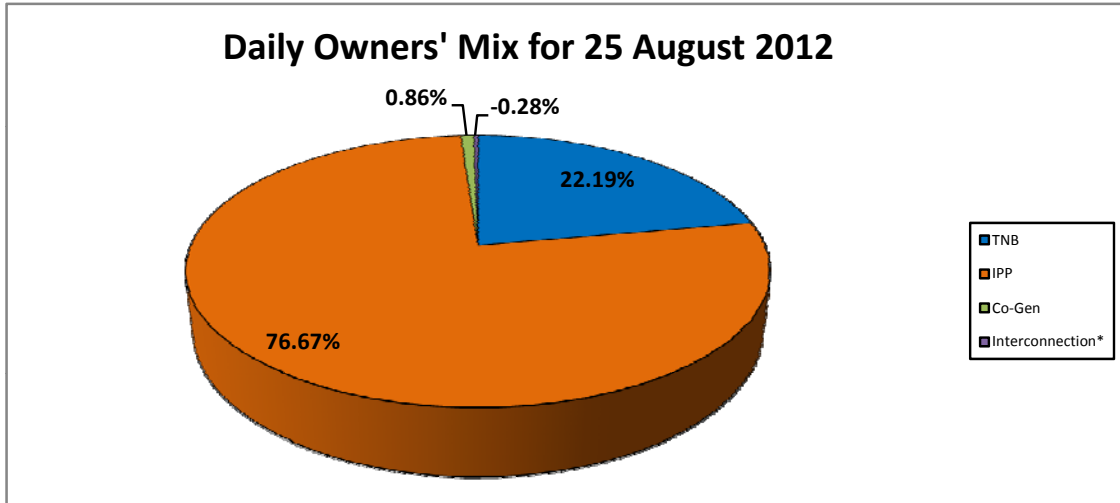

Daily Generation Mix for 25 August 2012

ST-Coal	112,632 MWh
ST-Oil	80 MWh
ST-Gas	- MWh
Gas	143,966 MWh
Hydro	12,599 MWh
Distillate	- MWh
Co-Gen	2,347 MWh
SPORE*	(62) MWh
EGAT*	(703) MWh

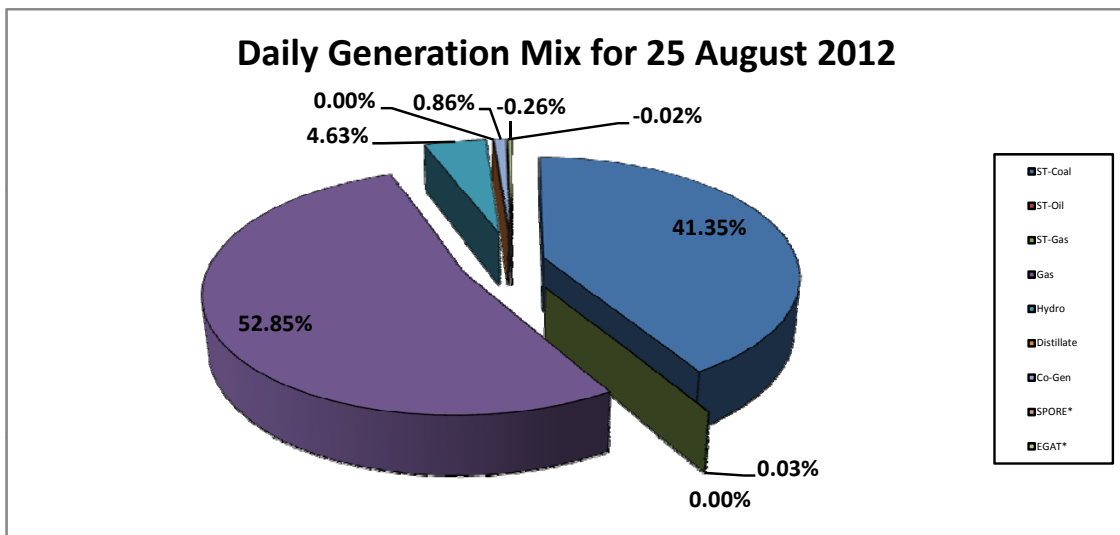

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand