

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 28 August 2012	14,794 MW	14,557 MW	-1.60%	
Energy Demand for 28 August 2012	309.65 GWh	305.44 GWh	-1.36%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

29-Aug-12


Daily Owners' Mix for 28 August 2012

TNB	69,889 MWh
IPP	233,919 MWh
Co-Gen	2,364 MWh
Interconnection*	730 MWh

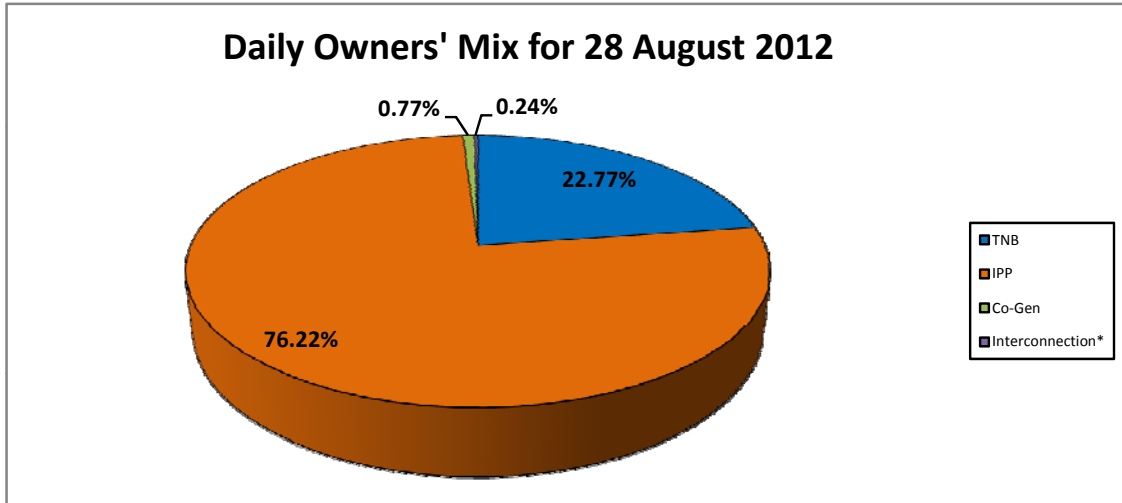

Daily Generation Mix for 28 August 2012

ST-Coal	112,472 MWh
ST-Oil	9,506 MWh
ST-Gas	- MWh
Gas	167,750 MWh
Hydro	11,862 MWh
Distillate	2,218 MWh
Co-Gen	2,364 MWh
SPORE*	(4) MWh
EGAT*	734 MWh

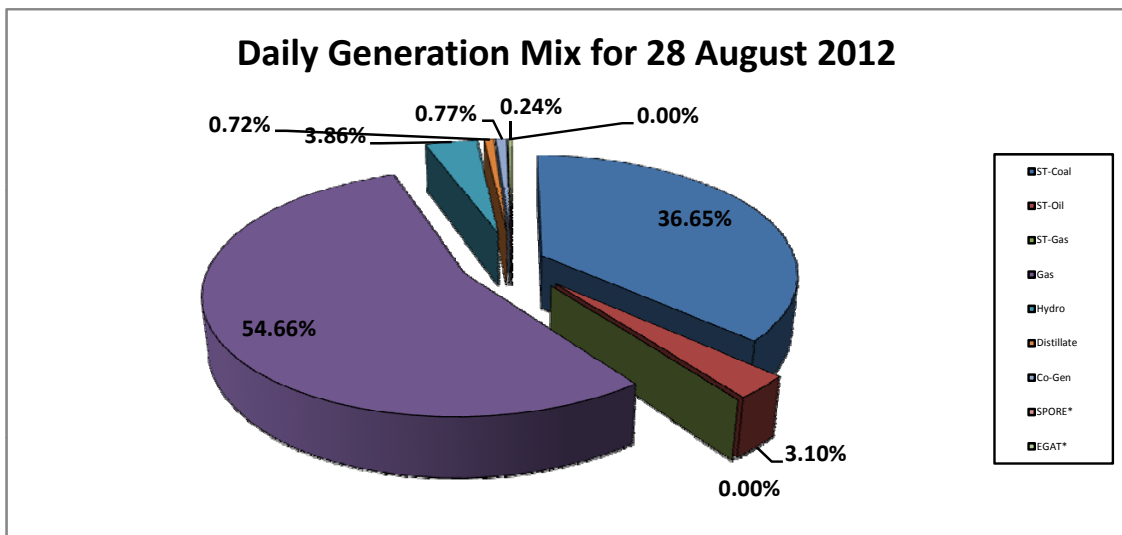

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand