

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 29 August 2012	14,815 MW	14,964 MW	1.01%	
Energy Demand for 29 August 2012	308.23 GWh	310.00 GWh	0.57%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

30-Aug-12


Daily Owners' Mix for 29 August 2012

TNB	68,840 MWh
IPP	239,561 MWh
Co-Gen	2,347 MWh
Interconnection*	747 MWh

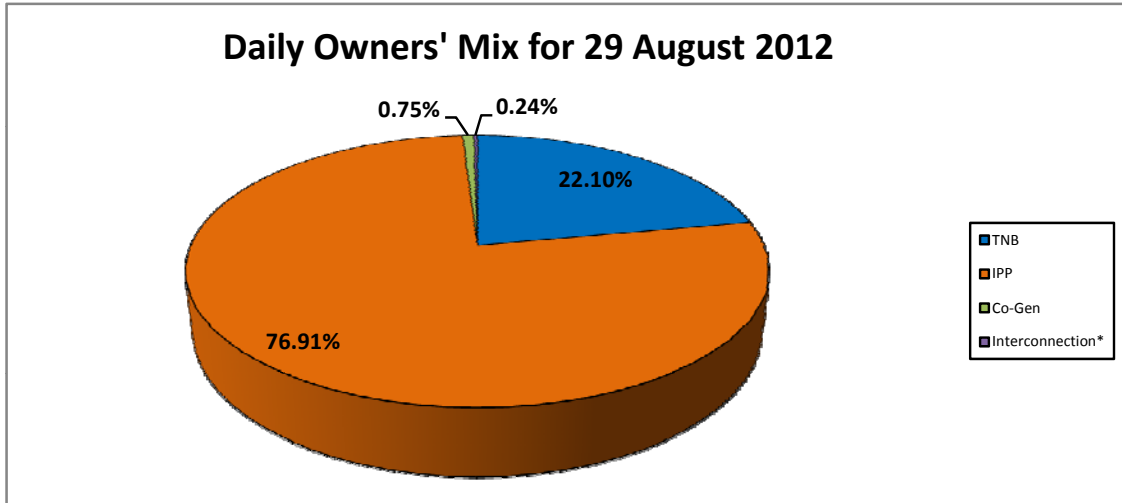

Daily Generation Mix for 29 August 2012

ST-Coal	127,268 MWh
ST-Oil	13,066 MWh
ST-Gas	- MWh
Gas	157,748 MWh
Hydro	10,319 MWh
Distillate	- MWh
Co-Gen	2,347 MWh
SPORE*	17 MWh
EGAT*	730 MWh

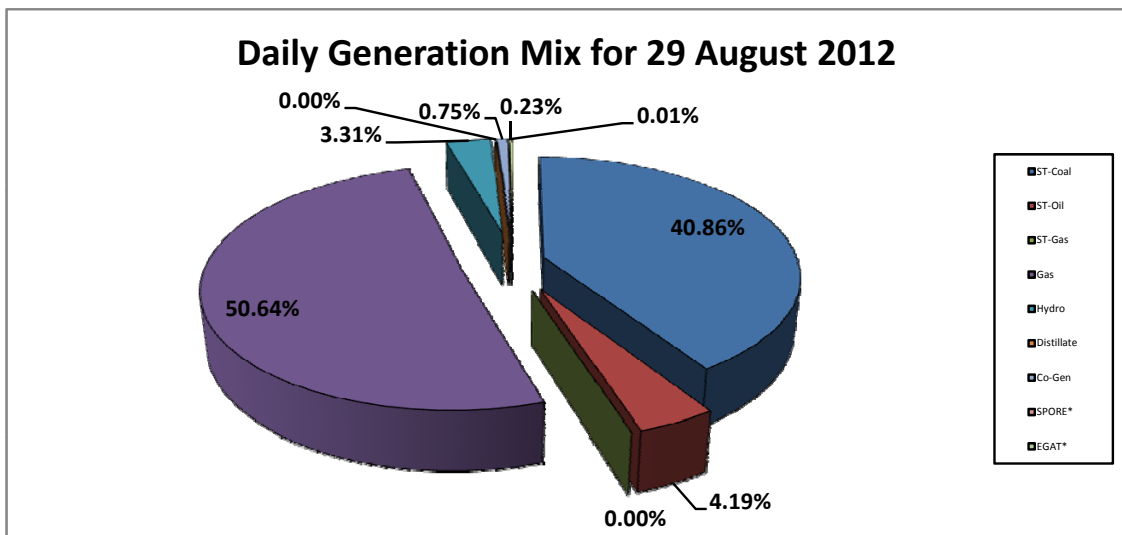

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand