

## GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 30 August 2012	15,077 MW	14,867 MW	-1.39%	
Energy Demand for 30 August 2012	313.30 GWh	309.77 GWh	-1.13%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

31-Aug-12


**Daily Owners' Mix for 30 August 2012**

<b>TNB</b>	71,865 MWh
<b>IPP</b>	236,608 MWh
<b>Co-Gen</b>	2,305 MWh
<b>Interconnection*</b>	1,012 MWh

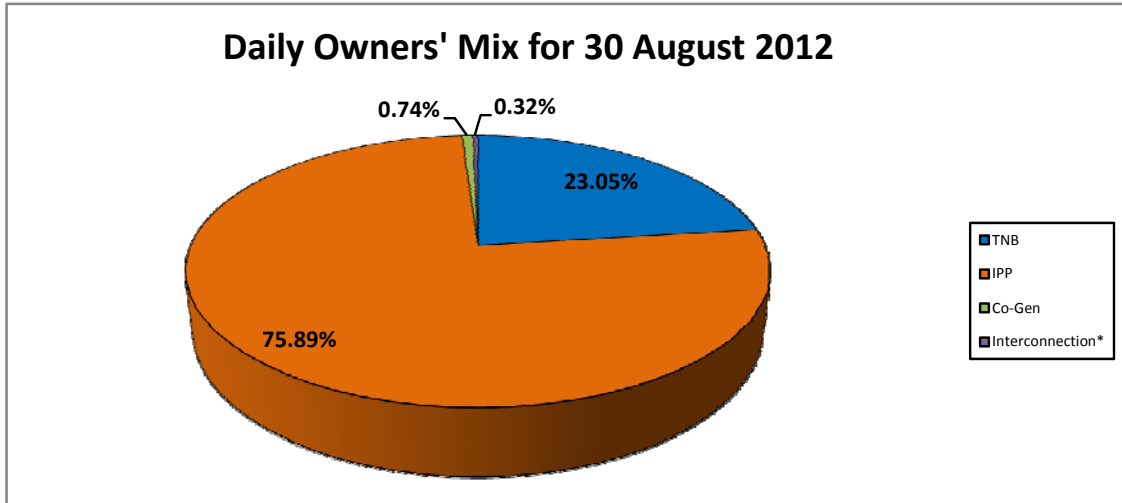

**Daily Generation Mix for 30 August 2012**

<b>ST-Coal</b>	129,435 MWh
<b>ST-Oil</b>	11,755 MWh
<b>ST-Gas</b>	- MWh
<b>Gas</b>	155,974 MWh
<b>Hydro</b>	11,309 MWh
<b>Distillate</b>	- MWh
<b>Co-Gen</b>	2,305 MWh
<b>SPORE*</b>	280 MWh
<b>EGAT*</b>	732 MWh

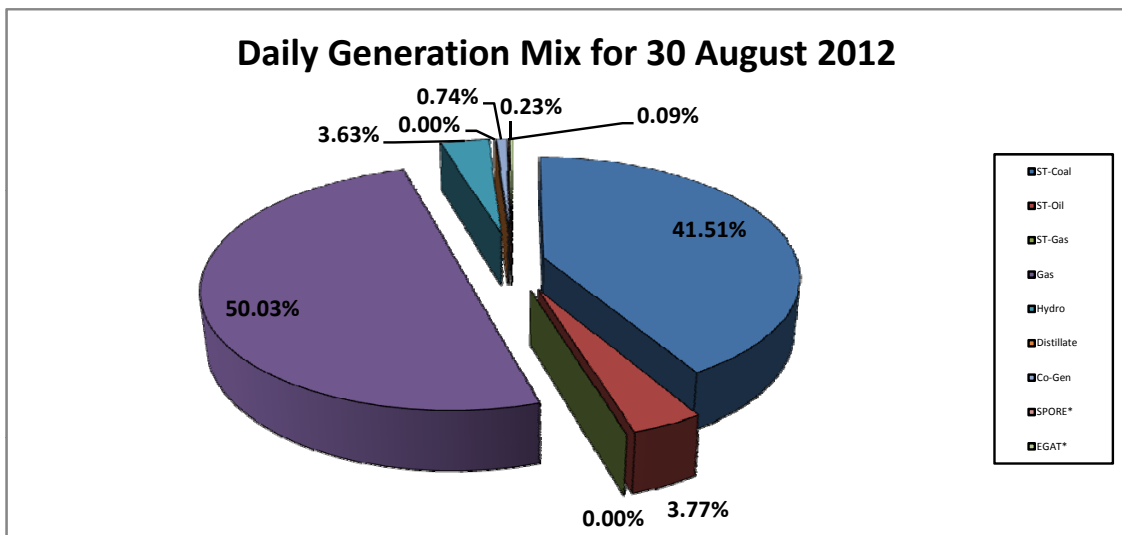

\*Negative = energy is imported from Singapore and Thailand  
 Positive = energy is exported to Singapore and Thailand