

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 2 September 2012	12,616 MW	13,006 MW	3.09%	
Energy Demand for 2 September 2012	268.01 GWh	272.98 GWh	1.85%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

03-Sep-12


Daily Owners' Mix for 2 September 2012

TNB	66,253 MWh
IPP	205,738 MWh
Co-Gen	2,117 MWh
Interconnection*	1,128 MWh

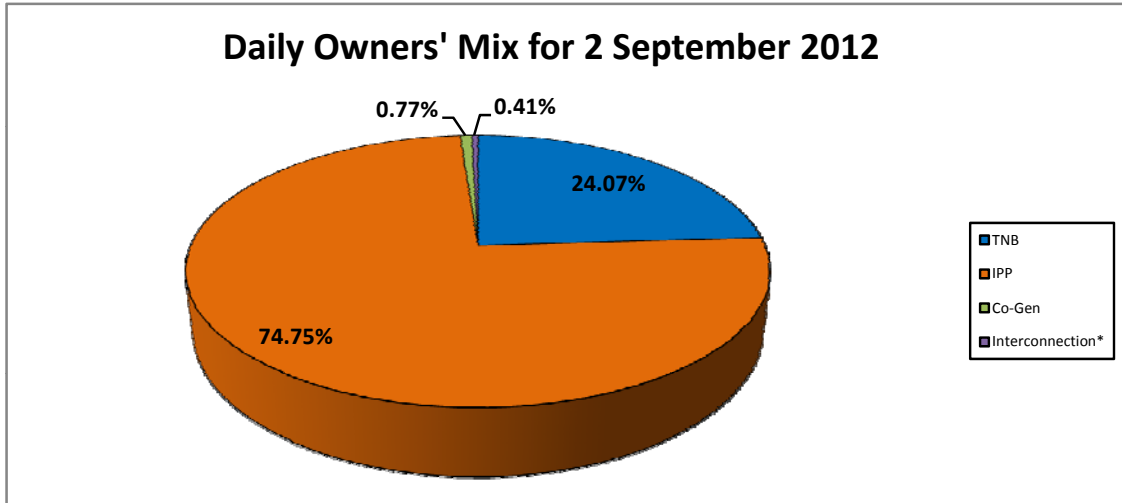

Daily Generation Mix for 2 September 2012

ST-Coal	133,686 MWh
ST-Oil	515 MWh
ST-Gas	- MWh
Gas	129,707 MWh
Hydro	8,083 MWh
Distillate	- MWh
Co-Gen	2,117 MWh
SPORE*	401 MWh
EGAT*	727 MWh

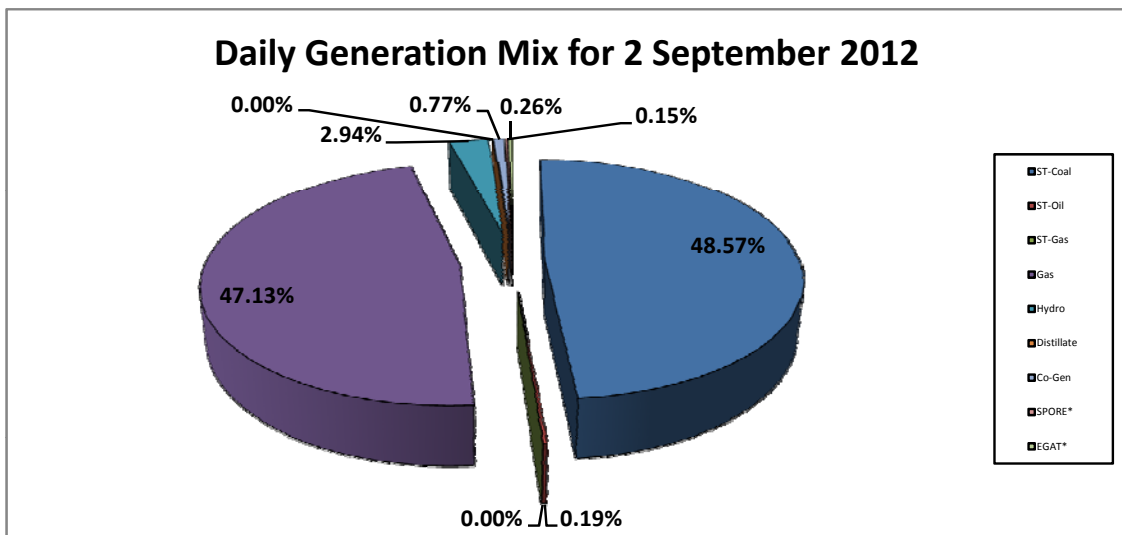

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand