

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 5 September 2012	15,121 MW	14,996 MW	-0.83%	
Energy Demand for 5 September 2012	320.94 GWh	315.07 GWh	-1.83%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

06-Sep-12


Daily Owners' Mix for 5 September 2012

TNB	77,877 MWh
IPP	233,267 MWh
Co-Gen	2,084 MWh
Interconnection*	(466) MWh

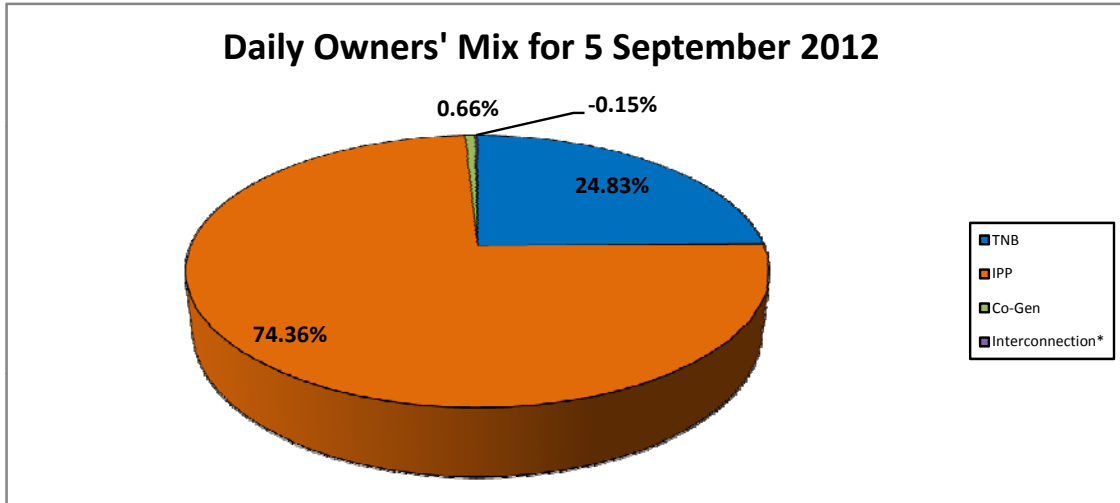

Daily Generation Mix for 5 September 2012

ST-Coal	129,178 MWh
ST-Oil	13,387 MWh
ST-Gas	- MWh
Gas	146,439 MWh
Hydro	12,351 MWh
Distillate	9,789 MWh
Co-Gen	2,084 MWh
SPORE*	233 MWh
EGAT*	(699) MWh

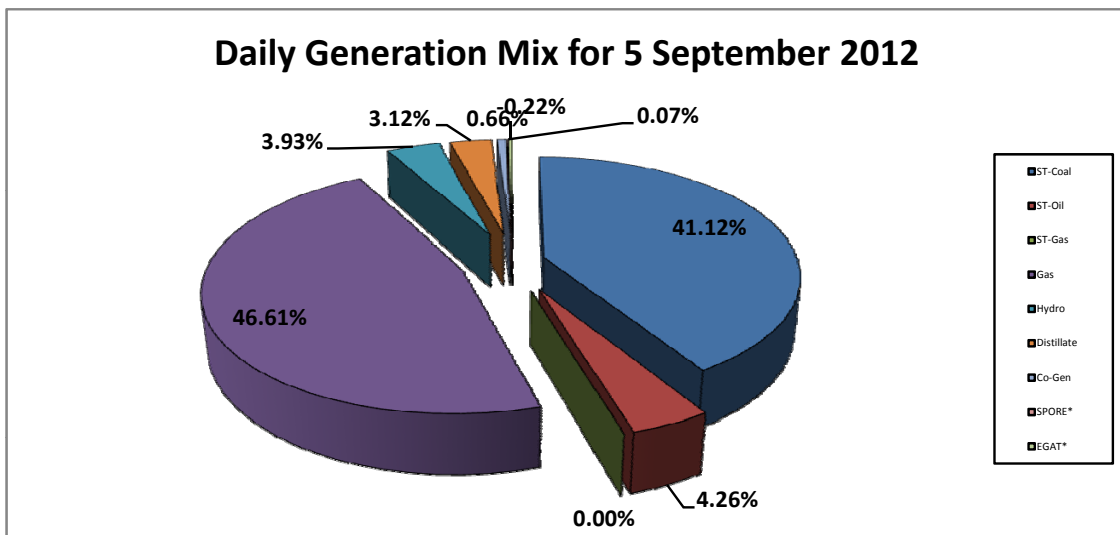

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand