

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 6 September 2012	15,128 MW	14,870 MW	-1.71%	
Energy Demand for 6 September 2012	313.11 GWh	311.45 GWh	-0.53%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

07-Sep-12


Daily Owners' Mix for 6 September 2012

TNB	75,756 MWh
IPP	233,449 MWh
Co-Gen	2,201 MWh
Interconnection*	(44) MWh

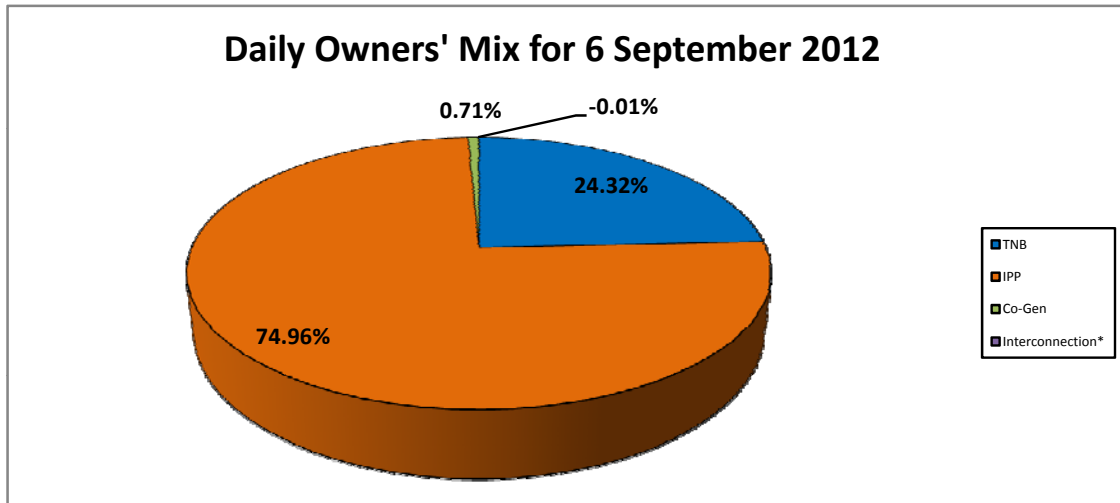

Daily Generation Mix for 6 September 2012

ST-Coal	126,059 MWh
ST-Oil	13,311 MWh
ST-Gas	- MWh
Gas	132,184 MWh
Hydro	15,783 MWh
Distillate	21,868 MWh
Co-Gen	2,201 MWh
SPORE*	(468) MWh
EGAT*	424 MWh

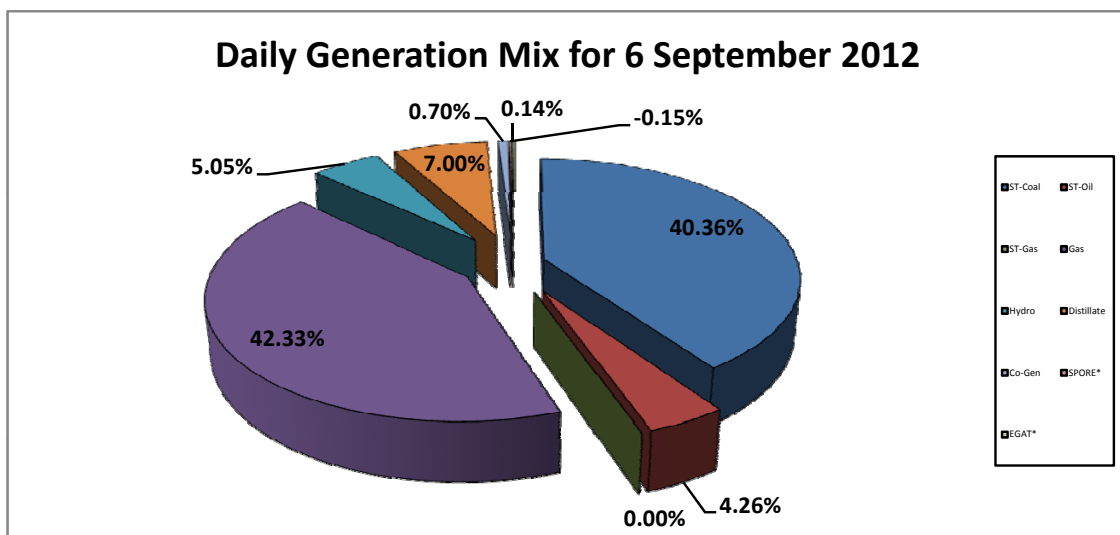

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand