

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 7 September 2012	15,094 MW	15,066 MW	-0.19%	
Energy Demand for 7 September 2012	314.30 GWh	313.05 GWh	-0.40%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

08-Sep-12


Daily Owners' Mix for 7 September 2012

TNB	80,145 MWh
IPP	230,000 MWh
Co-Gen	2,214 MWh
Interconnection*	(682) MWh

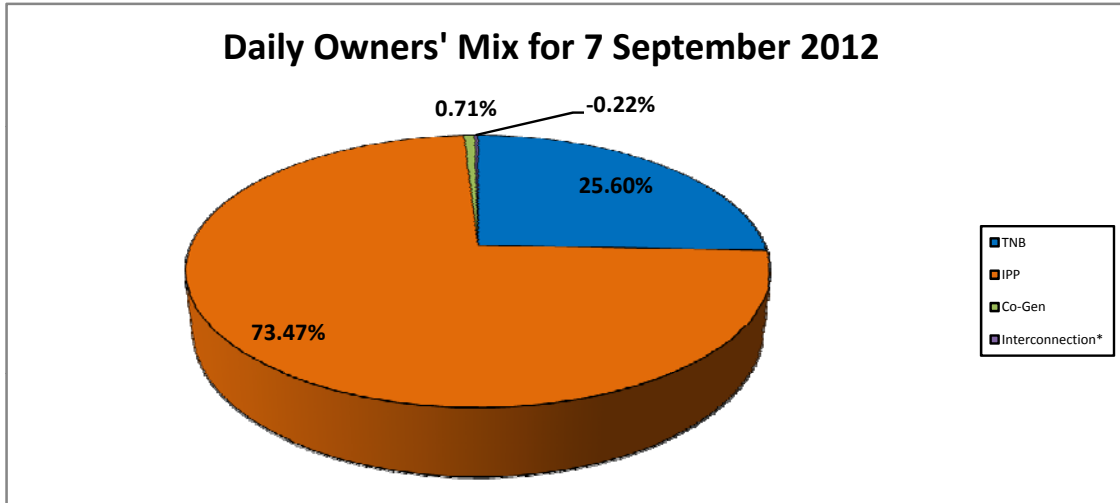

Daily Generation Mix for 7 September 2012

ST-Coal	123,584 MWh
ST-Oil	13,140 MWh
ST-Gas	463 MWh
Gas	143,584 MWh
Hydro	12,342 MWh
Distillate	19,032 MWh
Co-Gen	2,214 MWh
SPORE*	17 MWh
EGAT*	(699) MWh

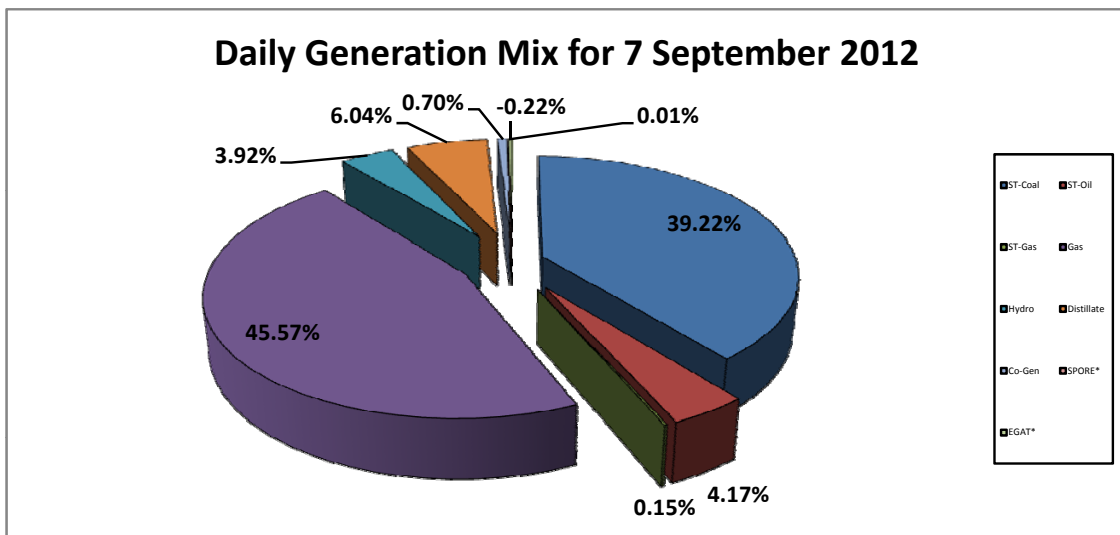

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand