

## GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 8 September 2012	13,252 MW	13,248 MW	-0.03%	
Energy Demand for 8 September 2012	292.58 GWh	291.30 GWh	-0.44%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

09-Sep-12


**Daily Owners' Mix for 8 September 2012**

TNB	58,682 MWh
IPP	229,762 MWh
Co-Gen	2,309 MWh
Interconnection*	(547) MWh

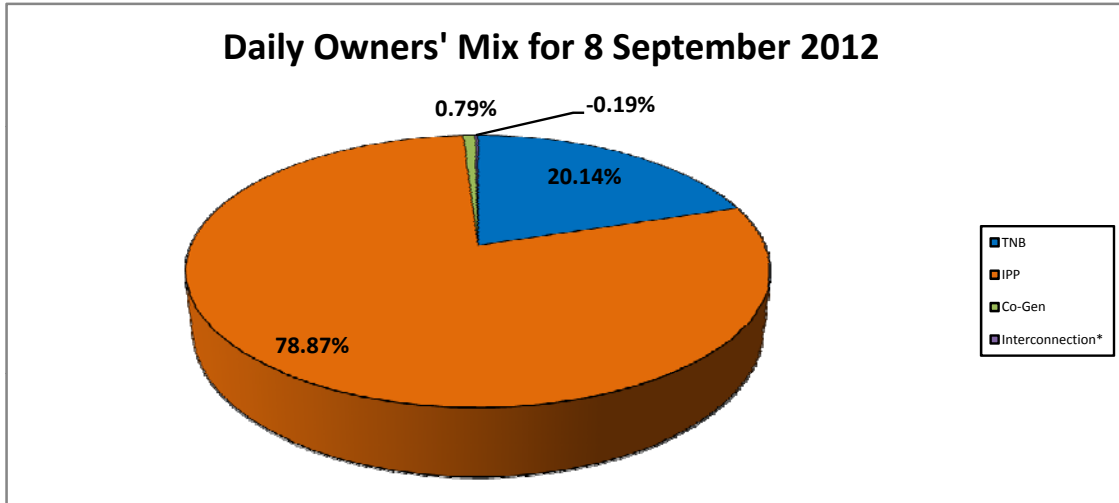

**Daily Generation Mix for 8 September 2012**

ST-Coal	142,755 MWh
ST-Oil	1,248 MWh
ST-Gas	600 MWh
Gas	135,963 MWh
Hydro	7,878 MWh
Distillate	- MWh
Co-Gen	2,309 MWh
SPORE*	156 MWh
EGAT*	(703) MWh

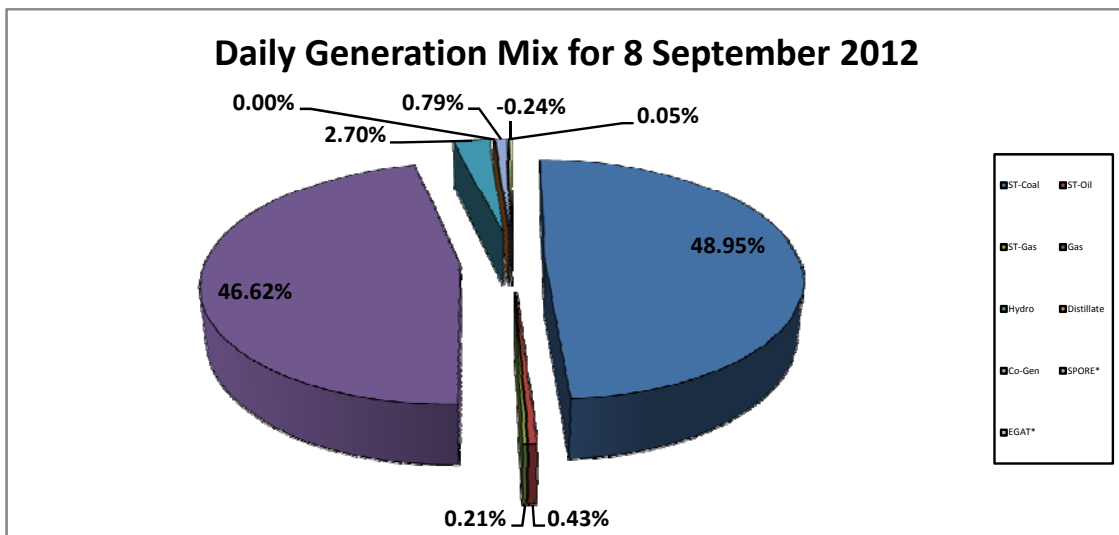

\*Negative = energy is imported from Singapore and Thailand  
 Positive = energy is exported to Singapore and Thailand