

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 10 September 2012	14,837 MW	15,176 MW	2.28%	
Energy Demand for 10 September 2012	305.66 GWh	309.85 GWh	1.37%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

11-Sep-12


Daily Owners' Mix for 10 September 2012

TNB	66,410 MWh
IPP	241,959 MWh
Co-Gen	2,356 MWh
Interconnection*	880 MWh

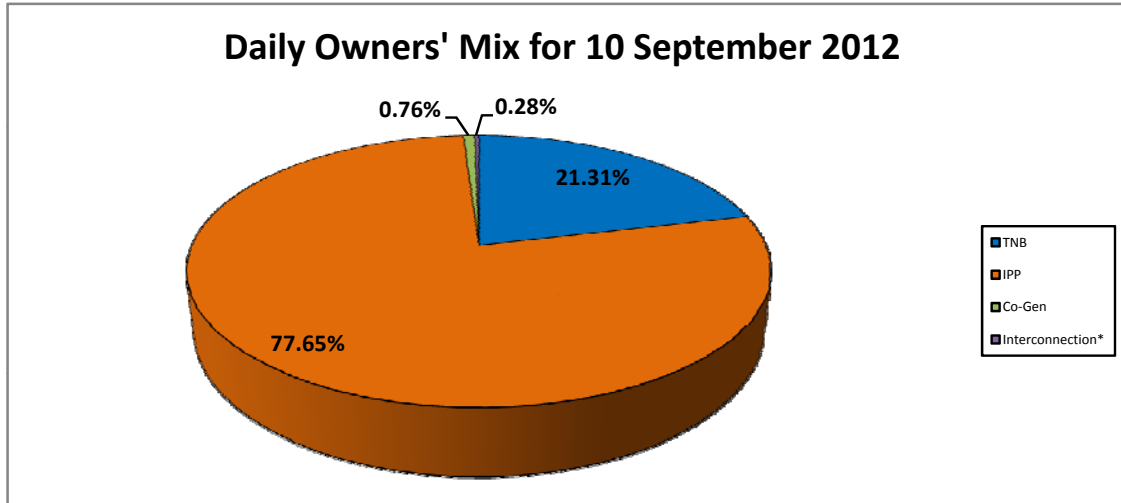

Daily Generation Mix for 10 September 2012

ST-Coal	142,742 MWh
ST-Oil	6,522 MWh
ST-Gas	- MWh
Gas	148,223 MWh
Hydro	10,882 MWh
Distillate	- MWh
Co-Gen	2,356 MWh
SPORE*	392 MWh
EGAT*	488 MWh

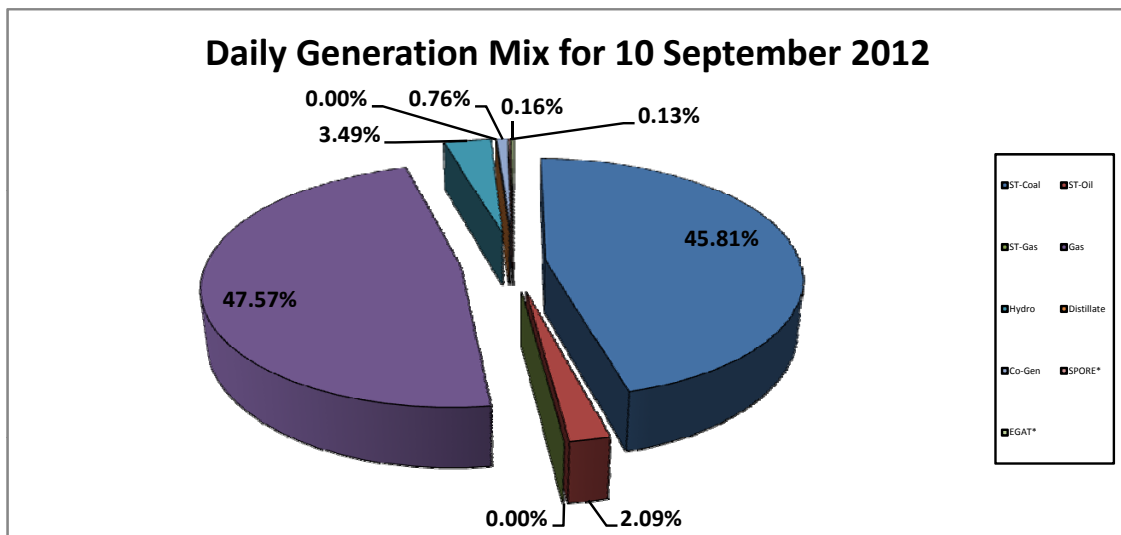

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand