

## GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 11 September 2012	14,997 MW	15,129 MW	0.88%	
Energy Demand for 11 September 2012	317.58 GWh	315.34 GWh	-0.71%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

12-Sep-12


**Daily Owners' Mix for 11 September 2012**

TNB	66,108 MWh
IPP	247,894 MWh
Co-Gen	2,352 MWh
Interconnection*	1,008 MWh

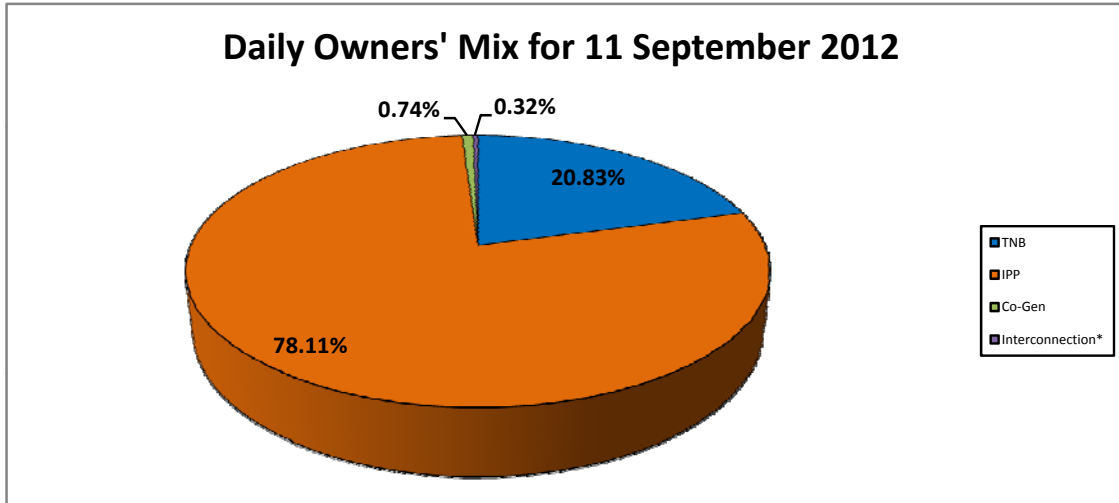

**Daily Generation Mix for 11 September 2012**

ST-Coal	143,746 MWh
ST-Oil	11,131 MWh
ST-Gas	- MWh
Gas	148,887 MWh
Hydro	10,238 MWh
Distillate	- MWh
Co-Gen	2,352 MWh
SPORE*	287 MWh
EGAT*	721 MWh

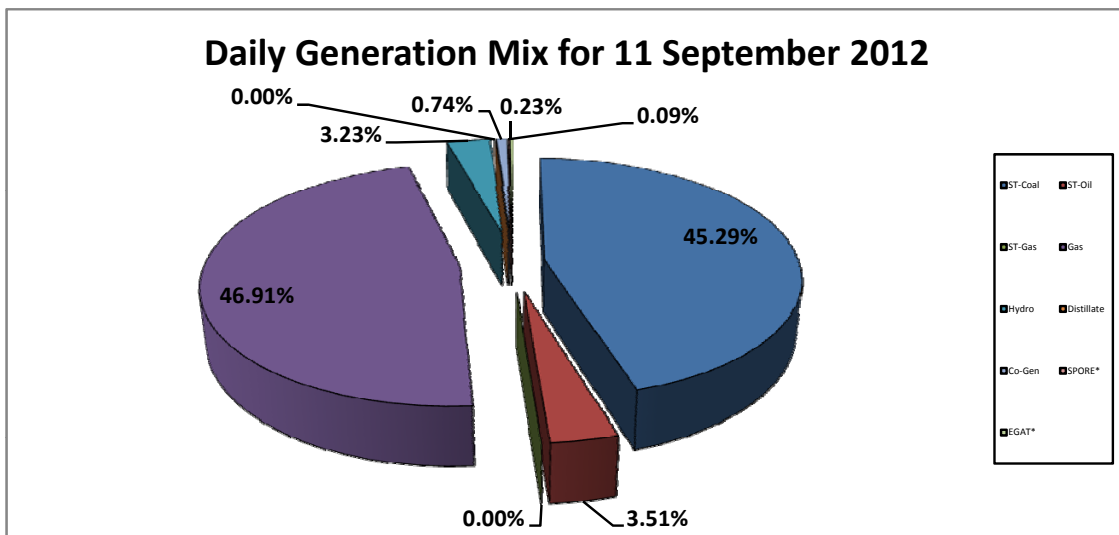

\*Negative = energy is imported from Singapore and Thailand  
 Positive = energy is exported to Singapore and Thailand