

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 12 September 2012	15,096 MW	14,913 MW	-1.21%	
Energy Demand for 12 September 2012	313.48 GWh	311.19 GWh	-0.73%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

13-Sep-12


Daily Owners' Mix for 12 September 2012

TNB	66,545 MWh
IPP	243,244 MWh
Co-Gen	2,287 MWh
Interconnection*	882 MWh

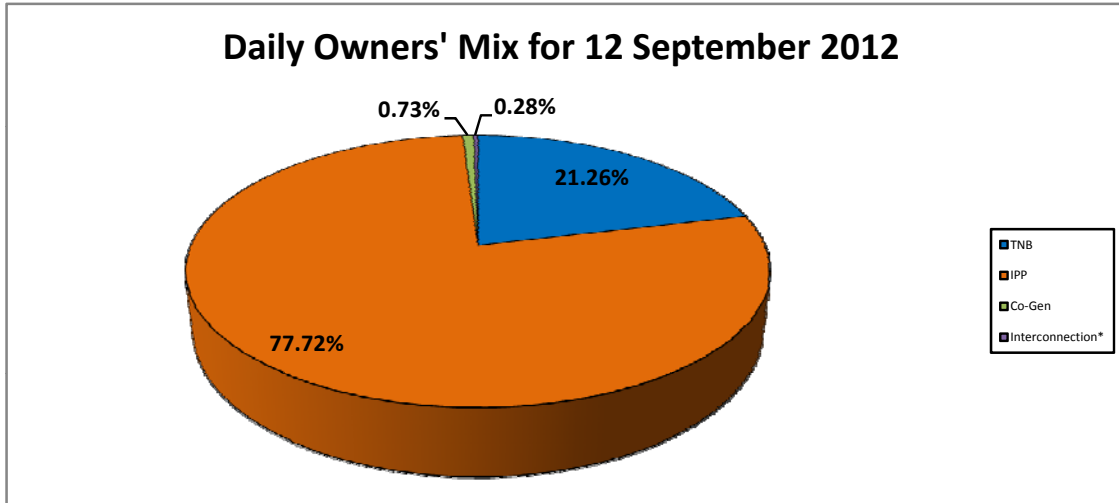

Daily Generation Mix for 12 September 2012

ST-Coal	141,766 MWh
ST-Oil	13,747 MWh
ST-Gas	- MWh
Gas	142,901 MWh
Hydro	11,375 MWh
Distillate	- MWh
Co-Gen	2,287 MWh
SPORE*	152 MWh
EGAT*	730 MWh

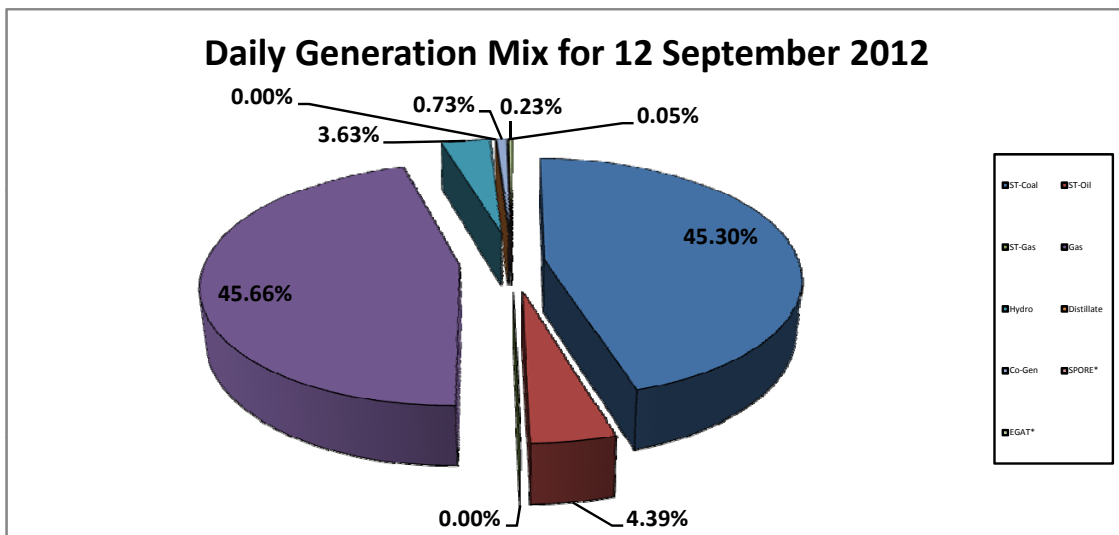

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand