

## GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 13 September 2012	15,236 MW	15,030 MW	-1.35%	
Energy Demand for 13 September 2012	316.04 GWh	311.92 GWh	-1.30%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

14-Sep-12


**Daily Owners' Mix for 13 September 2012**

TNB	69,804 MWh
IPP	240,872 MWh
Co-Gen	2,068 MWh
Interconnection*	813 MWh

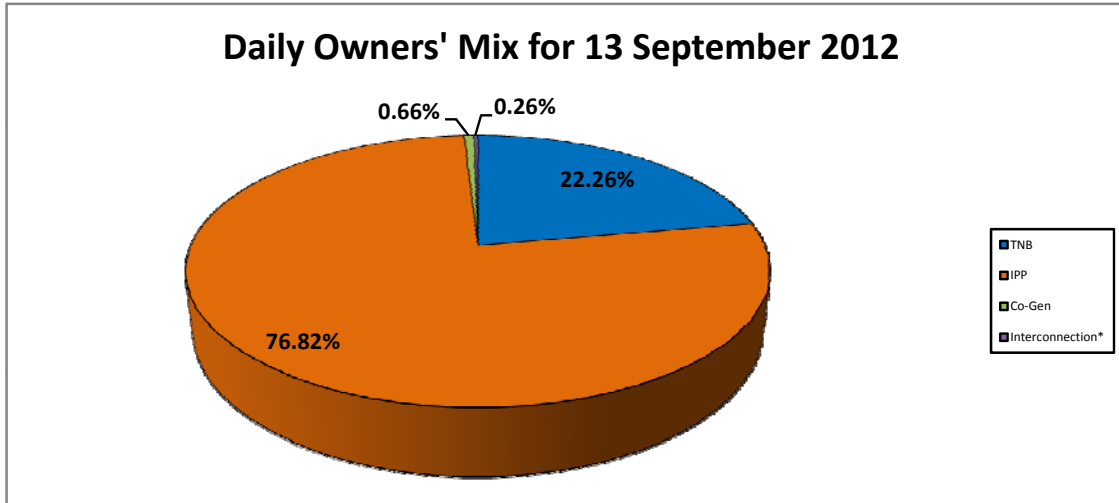

**Daily Generation Mix for 13 September 2012**

ST-Coal	126,732 MWh
ST-Oil	14,531 MWh
ST-Gas	- MWh
Gas	153,613 MWh
Hydro	12,380 MWh
Distillate	3,420 MWh
Co-Gen	2,068 MWh
SPORE*	83 MWh
EGAT*	730 MWh

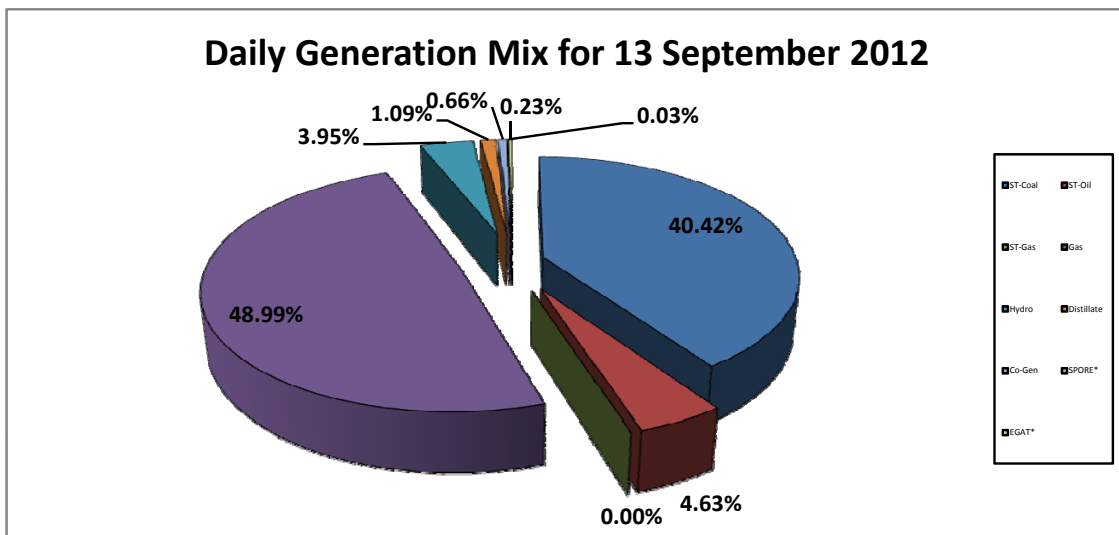

\*Negative = energy is imported from Singapore and Thailand  
 Positive = energy is exported to Singapore and Thailand