

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 14 September 2012	14,692 MW	14,740 MW	0.33%	
Energy Demand for 14 September 2012	312.05 GWh	306.70 GWh	-1.71%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

15-Sep-12


Daily Owners' Mix for 14 September 2012

TNB	68,855 MWh
IPP	236,815 MWh
Co-Gen	2,014 MWh
Interconnection*	981 MWh

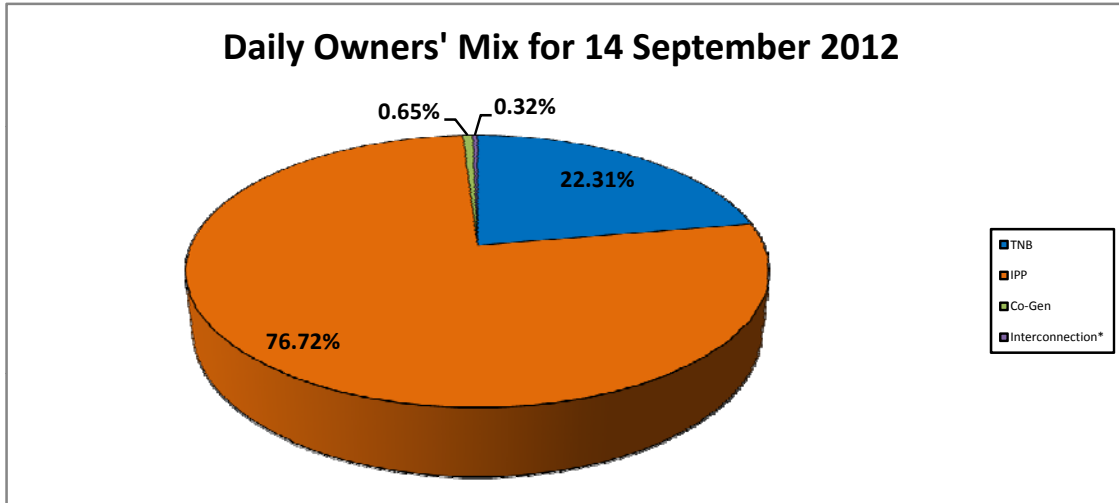

Daily Generation Mix for 14 September 2012

ST-Coal	115,566 MWh
ST-Oil	1,025 MWh
ST-Gas	- MWh
Gas	163,429 MWh
Hydro	12,202 MWh
Distillate	- MWh
Co-Gen	2,014 MWh
SPORE*	253 MWh
EGAT*	728 MWh

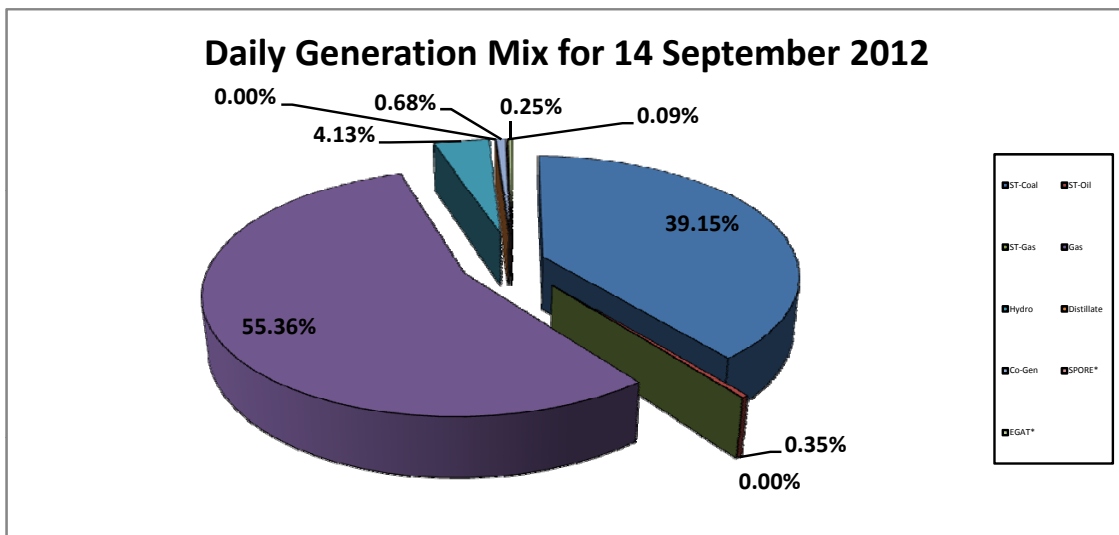

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand