

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 16 September 2012	12,813 MW	12,354 MW	-3.58%	
Energy Demand for 16 September 2012	273.51 GWh	262.58 GWh	-4.00%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

17-Sep-12


Daily Owners' Mix for 16 September 2012

TNB	45,422	MWh
IPP	216,007	MWh
Co-Gen	2,253	MWh
Interconnection*	1,103	MWh

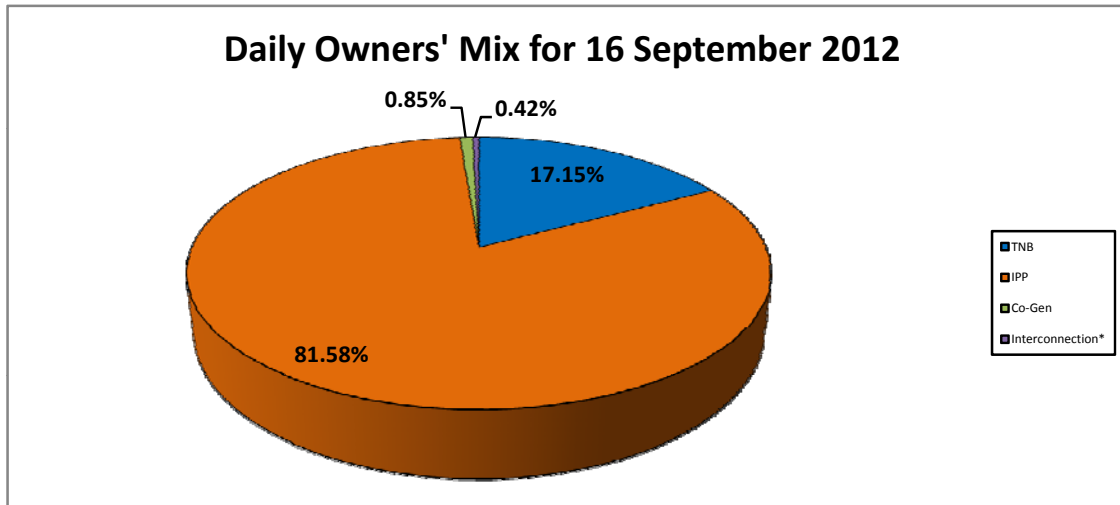

Daily Generation Mix for 16 September 2012

ST-Coal	128,653	MWh
ST-Oil	-	MWh
ST-Gas	-	MWh
Gas	124,364	MWh
Hydro	8,412	MWh
Distillate	-	MWh
Co-Gen	2,253	MWh
SPORE*	(119)	MWh
EGAT*	1,222	MWh

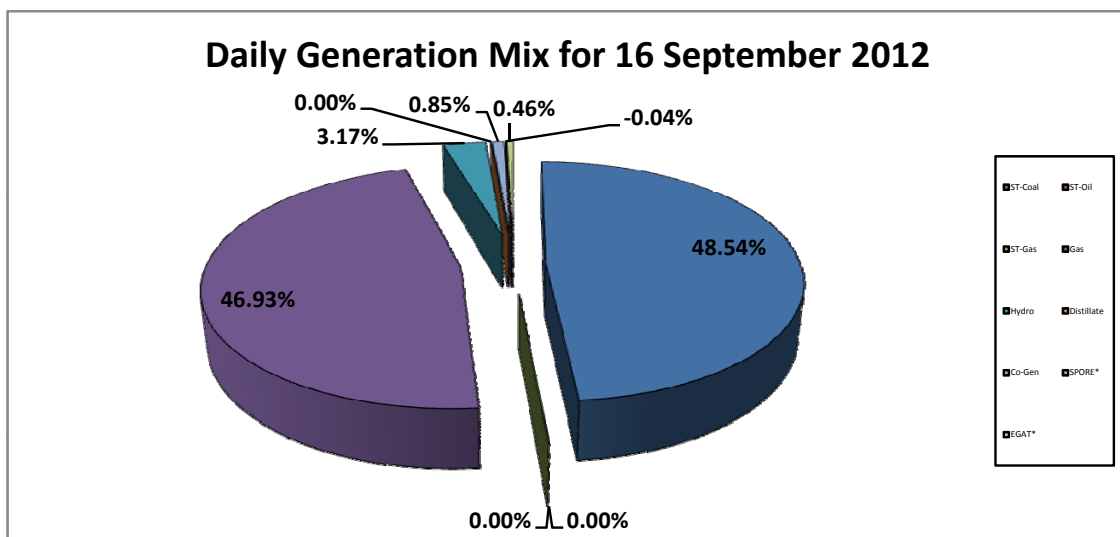

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand