

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 17 September 2012	13,073 MW	12,700 MW	-2.85%	
Energy Demand for 17 September 2012	273.22 GWh	267.26 GWh	-2.18%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

18-Sep-12


Daily Owners' Mix for 17 September 2012

TNB	43,339 MWh
IPP	220,694 MWh
Co-Gen	2,226 MWh
Interconnection*	(946) MWh

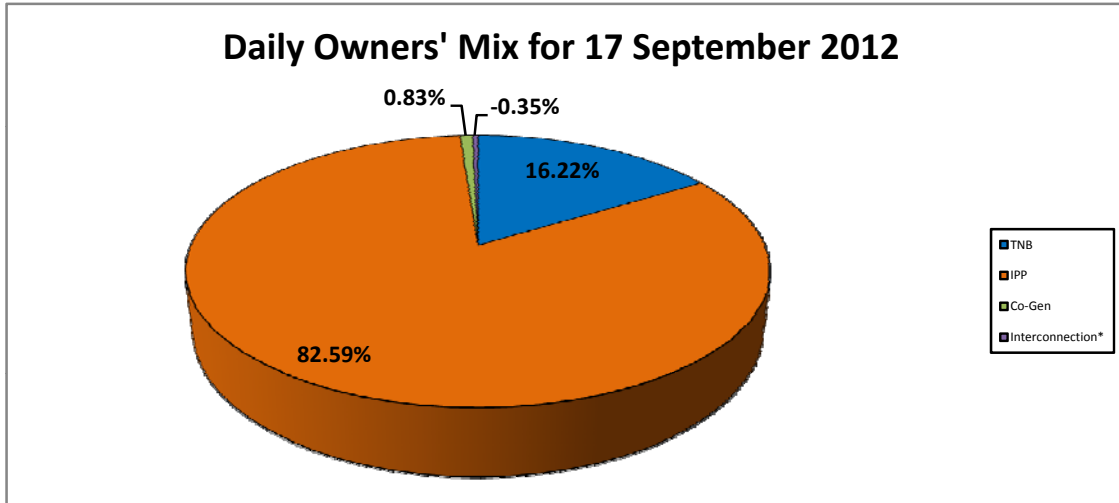

Daily Generation Mix for 17 September 2012

ST-Coal	141,737 MWh
ST-Oil	- MWh
ST-Gas	- MWh
Gas	113,506 MWh
Hydro	8,790 MWh
Distillate	- MWh
Co-Gen	2,226 MWh
SPORE*	(338) MWh
EGAT*	(608) MWh

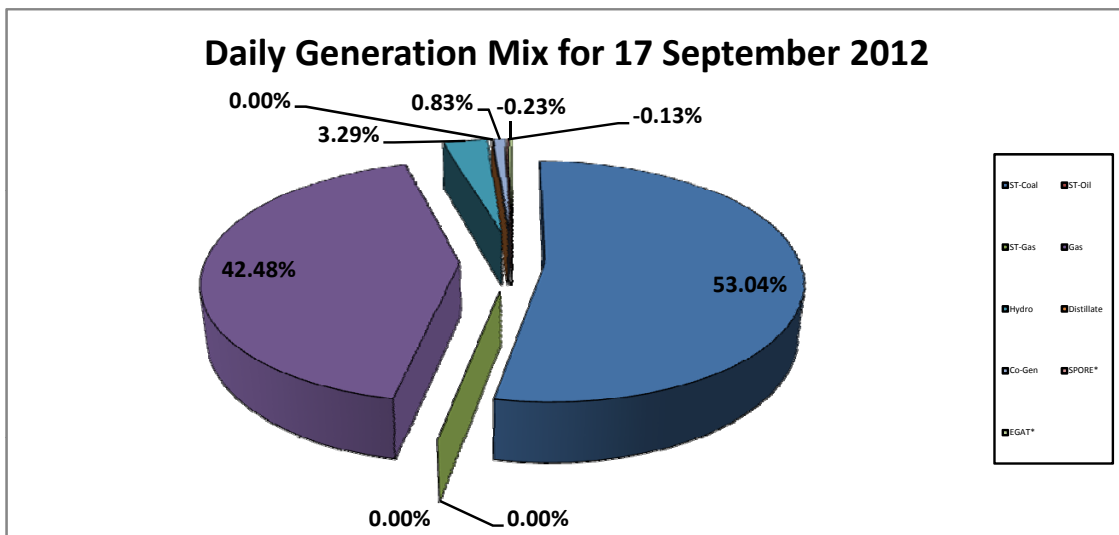

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand