

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 18 September 2012	14,988 MW	15,563 MW	3.84%	
Energy Demand for 18 September 2012	308.62 GWh	313.46 GWh	1.57%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

19-Sep-12


Daily Owners' Mix for 18 September 2012

TNB	66,530 MWh
IPP	244,136 MWh
Co-Gen	2,176 MWh
Interconnection*	(618) MWh

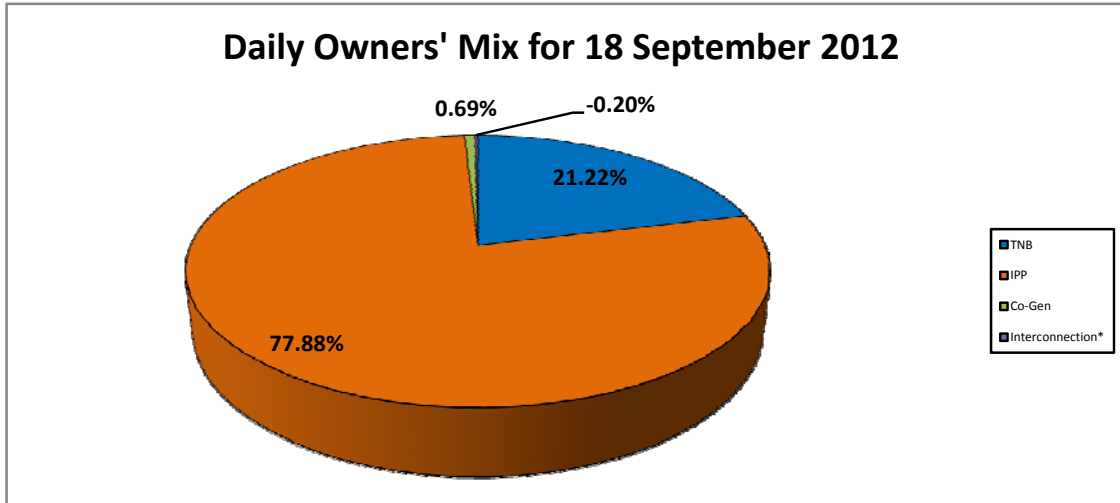

Daily Generation Mix for 18 September 2012

ST-Coal	141,400 MWh
ST-Oil	3,230 MWh
ST-Gas	- MWh
Gas	152,021 MWh
Hydro	14,015 MWh
Distillate	- MWh
Co-Gen	2,176 MWh
SPORE*	78 MWh
EGAT*	(696) MWh

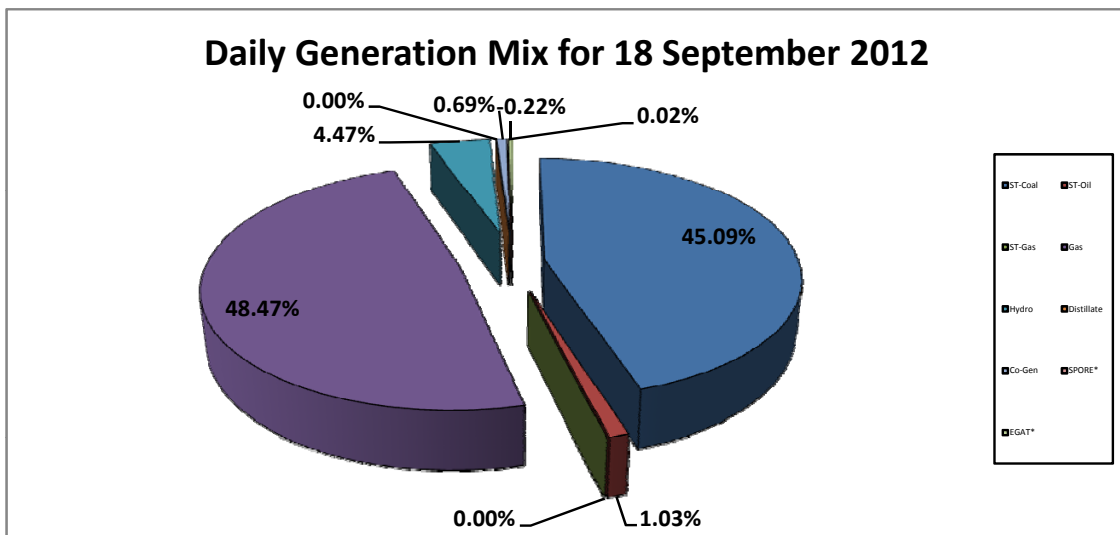

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand