

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 22 September 2012	13,226 MW	13,299 MW	0.55%	
Energy Demand for 22 September 2012	293.47 GWh	289.55 GWh	-1.34%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

23-Sep-12


Daily Owners' Mix for 22 September 2012

TNB	66,882 MWh
IPP	220,101 MWh
Co-Gen	1,976 MWh
Interconnection*	(586) MWh

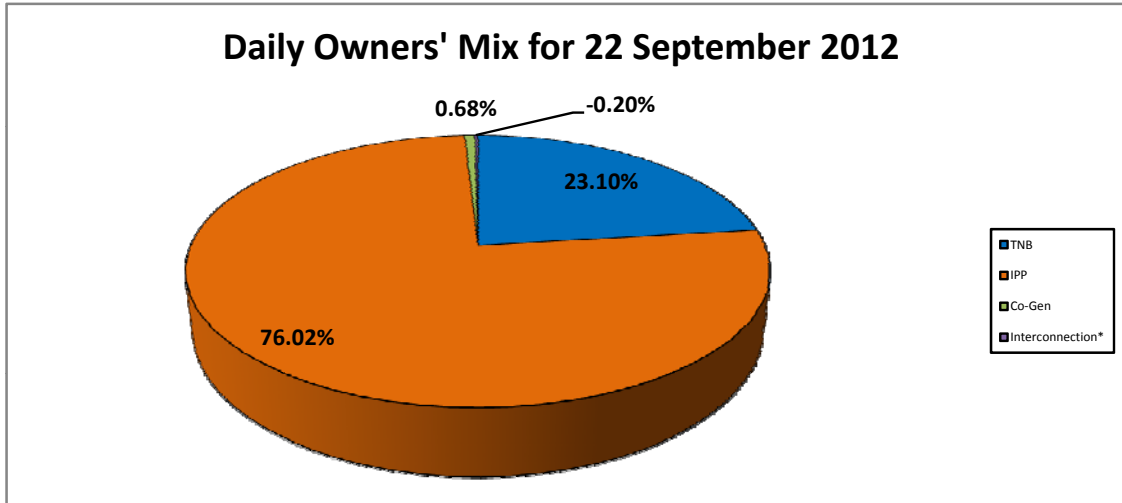

Daily Generation Mix for 22 September 2012

ST-Coal	126,043 MWh
ST-Oil	13,054 MWh
ST-Gas	- MWh
Gas	139,135 MWh
Hydro	8,751 MWh
Distillate	- MWh
Co-Gen	1,976 MWh
SPORE*	111 MWh
EGAT*	(697) MWh

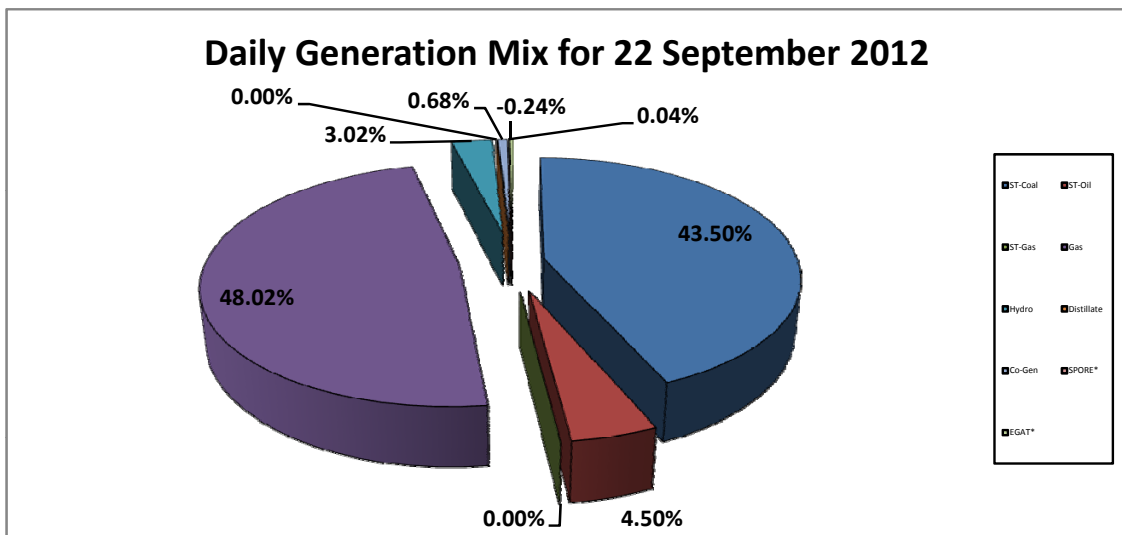

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand