

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 23 September 2012	12,939 MW	12,871 MW	-0.53%	
Energy Demand for 23 September 2012	278.05 GWh	273.89 GWh	-1.50%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

24-Sep-12


Daily Owners' Mix for 23 September 2012

TNB	68,712 MWh
IPP	202,797 MWh
Co-Gen	2,050 MWh
Interconnection*	(334) MWh

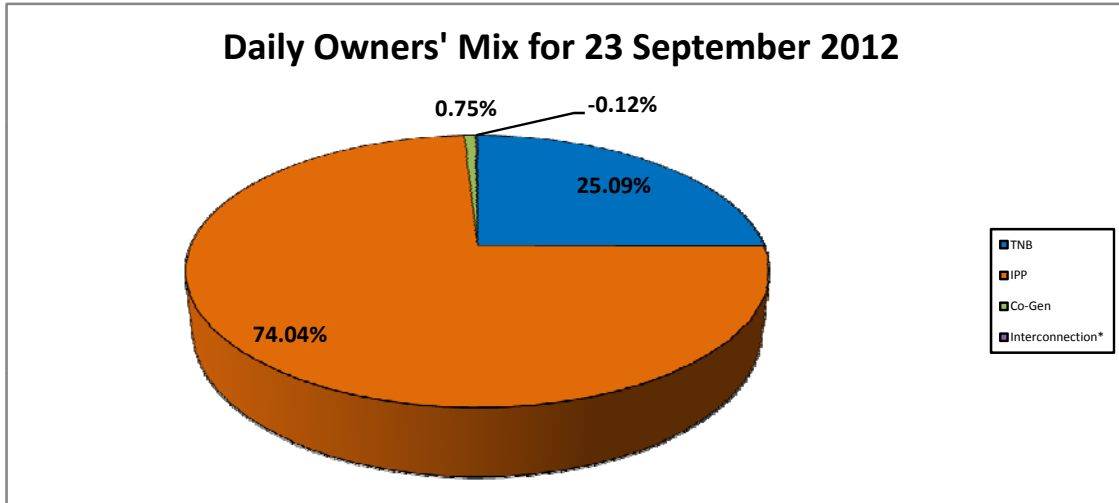

Daily Generation Mix for 23 September 2012

ST-Coal	121,551 MWh
ST-Oil	13,321 MWh
ST-Gas	423 MWh
Gas	127,125 MWh
Hydro	9,089 MWh
Distillate	- MWh
Co-Gen	2,050 MWh
SPORE*	(104) MWh
EGAT*	(230) MWh

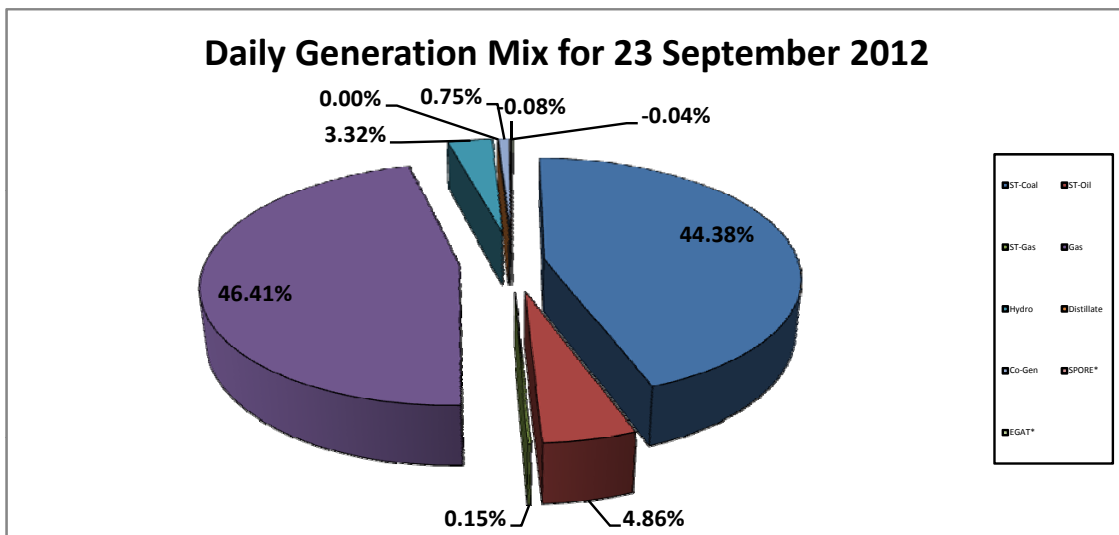

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand