

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 24 September 2012	15,333 MW	15,176 MW	-1.02%	
Energy Demand for 24 September 2012	314.06 GWh	312.26 GWh	-0.57%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

25-Sep-12


Daily Owners' Mix for 24 September 2012

TNB	79,974 MWh
IPP	230,940 MWh
Co-Gen	2,024 MWh
Interconnection*	680 MWh

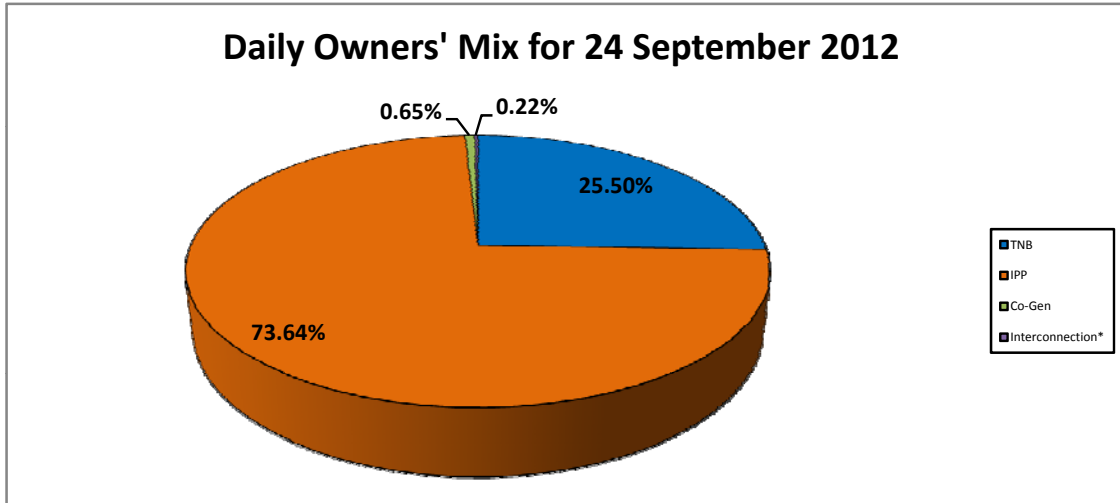

Daily Generation Mix for 24 September 2012

ST-Coal	120,023 MWh
ST-Oil	13,295 MWh
ST-Gas	- MWh
Gas	150,529 MWh
Hydro	13,159 MWh
Distillate	13,908 MWh
Co-Gen	2,024 MWh
SPORE*	41 MWh
EGAT*	639 MWh

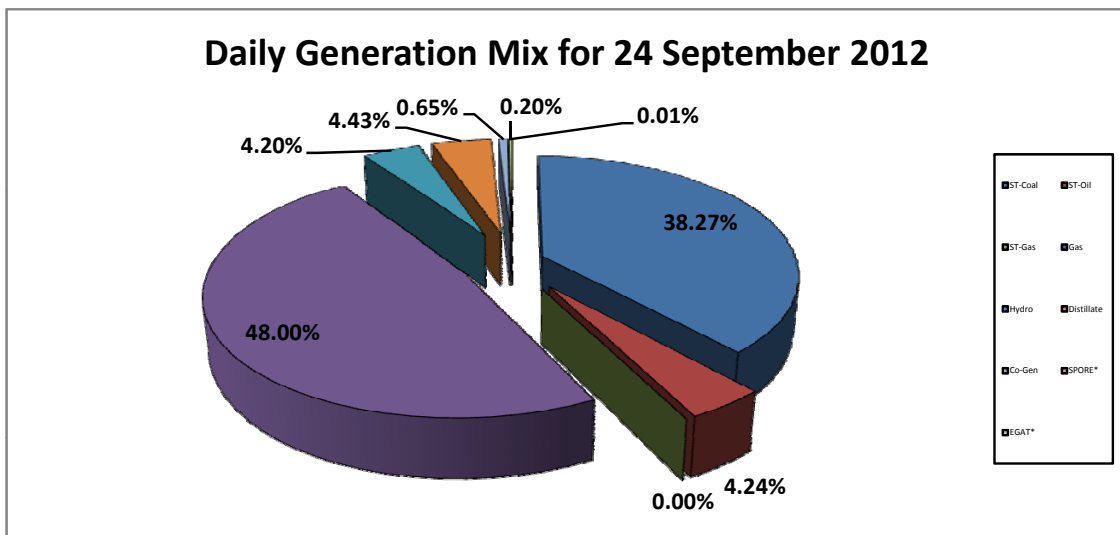

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand