

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 25 September 2012	15,205 MW	15,221 MW	0.11%	
Energy Demand for 25 September 2012	316.40 GWh	317.71 GWh	0.41%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

26-Sep-12


Daily Owners' Mix for 25 September 2012

TNB	80,603 MWh
IPP	235,733 MWh
Co-Gen	2,006 MWh
Interconnection*	632 MWh

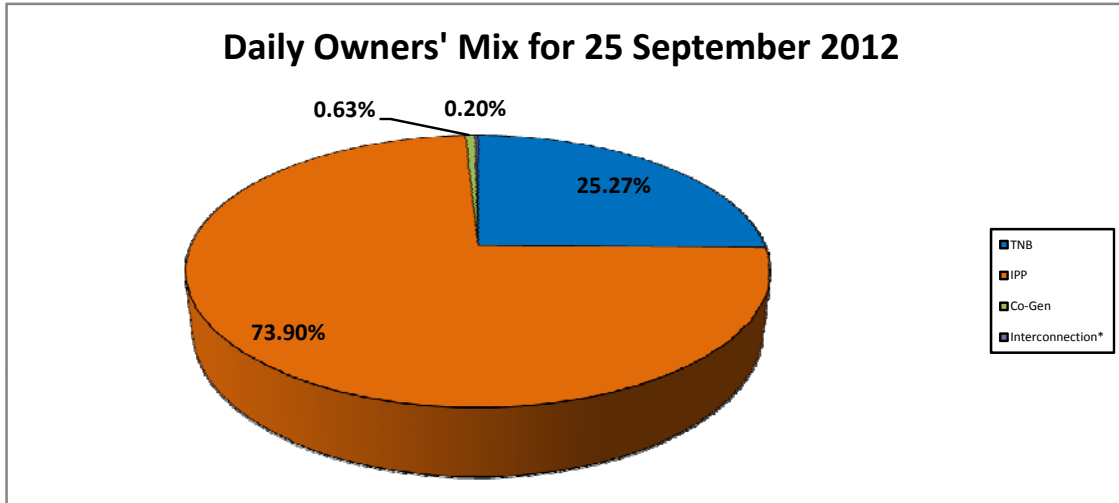

Daily Generation Mix for 25 September 2012

ST-Coal	119,868 MWh
ST-Oil	13,520 MWh
ST-Gas	- MWh
Gas	142,191 MWh
Hydro	12,347 MWh
Distillate	28,410 MWh
Co-Gen	2,006 MWh
SPORE*	(95) MWh
EGAT*	727 MWh

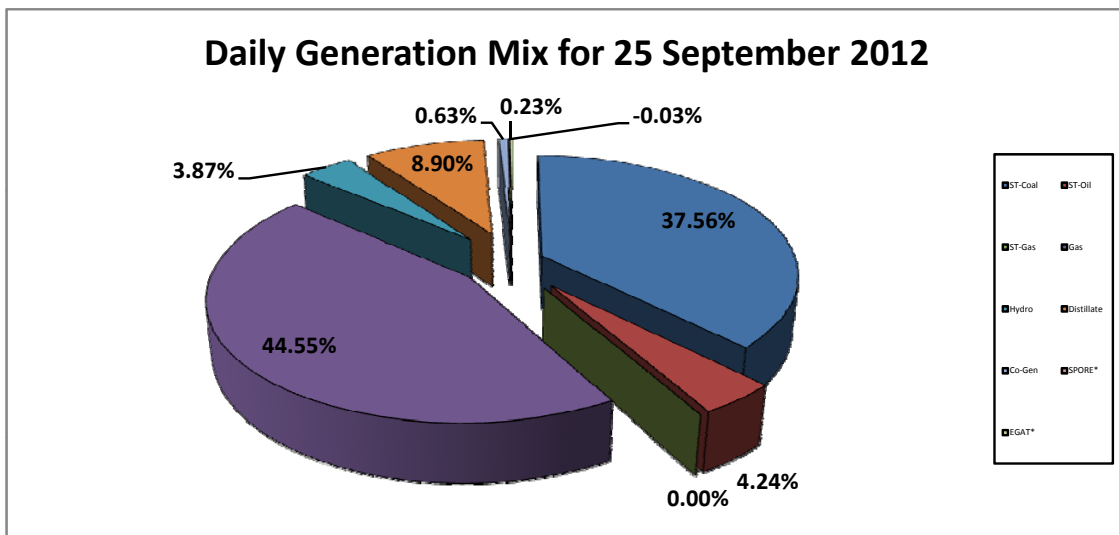

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand