

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 26 September 2012	15,160 MW	14,770 MW	-2.57%	
Energy Demand for 26 September 2012	316.94 GWh	310.19 GWh	-2.13%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

27-Sep-12


Daily Owners' Mix for 26 September 2012

TNB	76,548 MWh
IPP	232,300 MWh
Co-Gen	1,971 MWh
Interconnection*	629 MWh

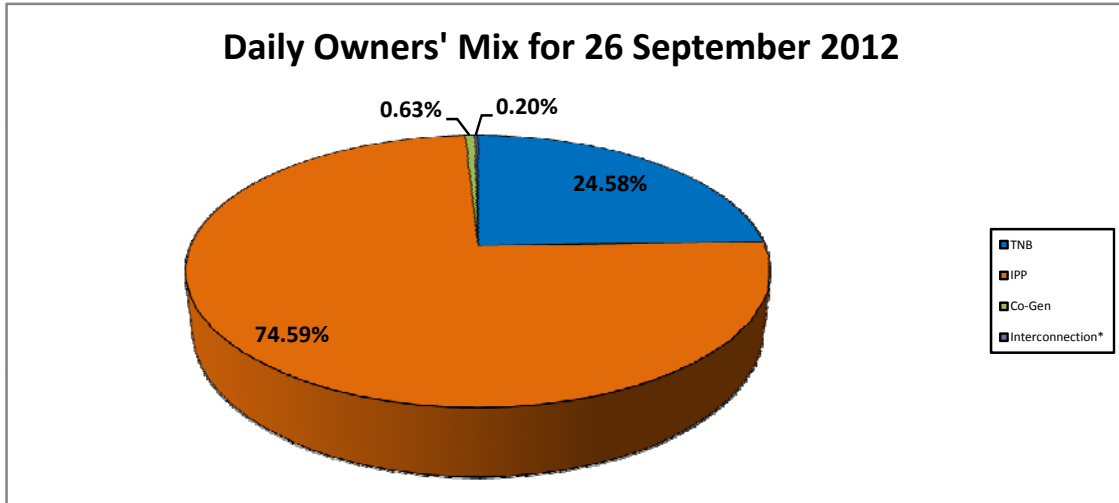

Daily Generation Mix for 26 September 2012

ST-Coal	119,096 MWh
ST-Oil	14,513 MWh
ST-Gas	- MWh
Gas	145,837 MWh
Hydro	11,007 MWh
Distillate	18,395 MWh
Co-Gen	1,971 MWh
SPORE*	(101) MWh
EGAT*	730 MWh

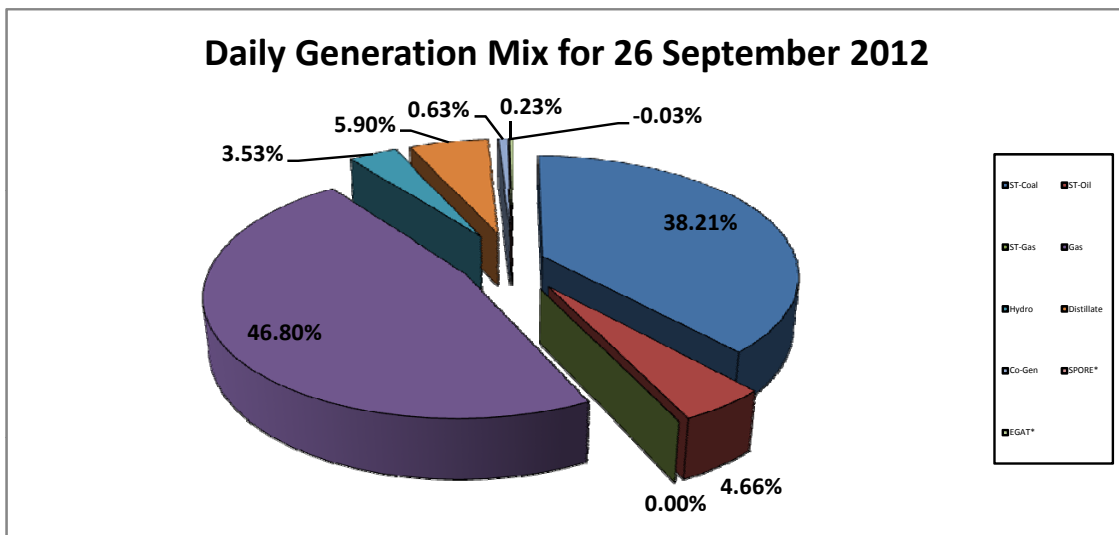

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand