

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 27 September 2012	14,923 MW	15,269 MW	2.32%	
Energy Demand for 27 September 2012	310.94 GWh	313.80 GWh	0.92%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

28-Sep-12


Daily Owners' Mix for 27 September 2012

TNB	78,983 MWh
IPP	233,459 MWh
Co-Gen	1,769 MWh
Interconnection*	412 MWh

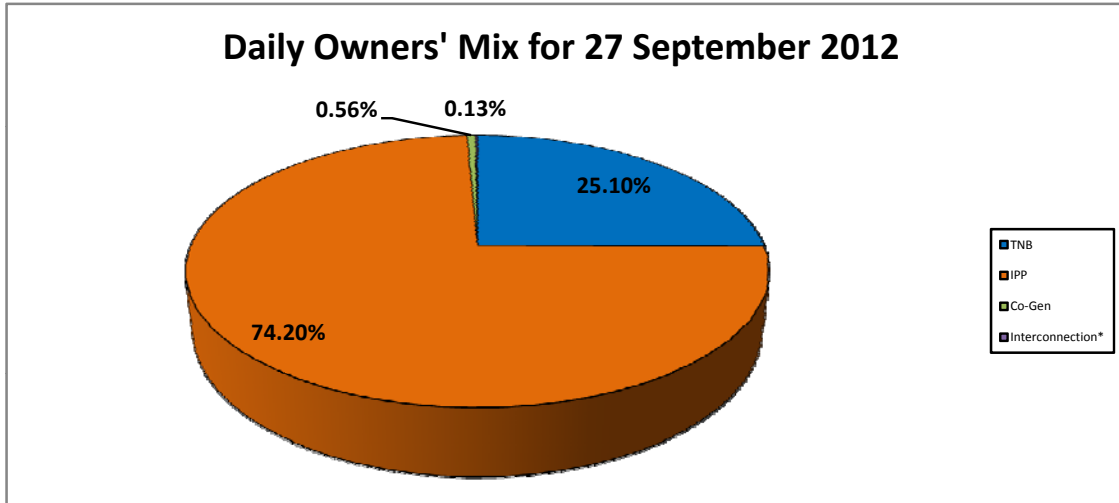

Daily Generation Mix for 27 September 2012

ST-Coal	132,618 MWh
ST-Oil	14,155 MWh
ST-Gas	- MWh
Gas	147,740 MWh
Hydro	13,819 MWh
Distillate	4,110 MWh
Co-Gen	1,769 MWh
SPORE*	(315) MWh
EGAT*	727 MWh

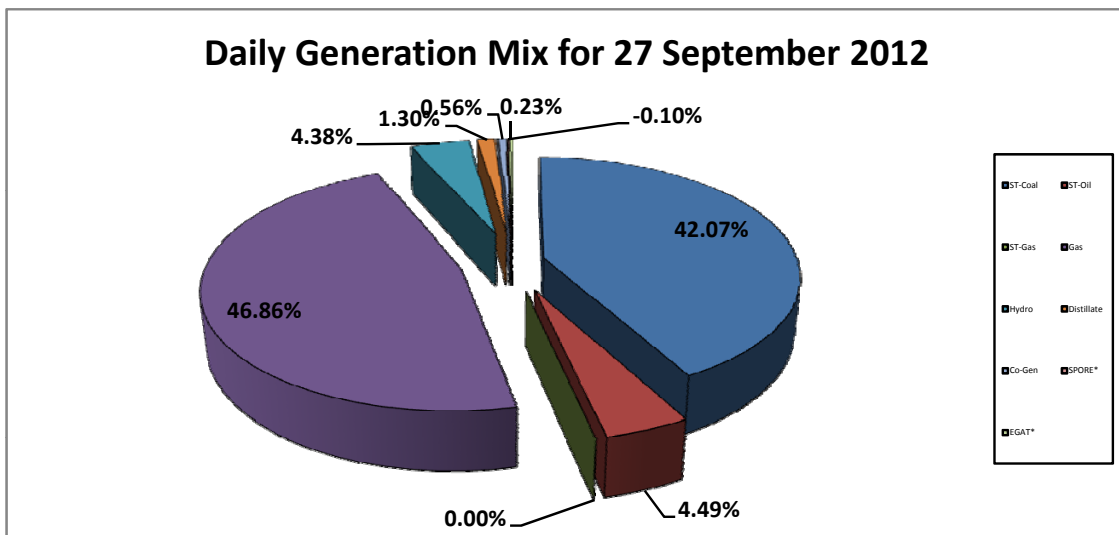

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand