

**GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)**

	<b>FORECAST</b>	<b>ACTUAL</b>	<b>VARIANCE</b>	
<b>Maximum Demand for 29 September 2012</b>	13,250 MW	13,427 MW	1.34%	
<b>Energy Demand for 29 September 2012</b>	290.54 GWh	292.31 GWh	0.61%	
<b>Highest Maximum Demand (20 June 2012)</b>	15,685 MW	15,826 MW	0.90%	<b>*New MD</b>
<b>Highest Daily Energy Demand (20 June 2012)</b>	326.75 GWh	328.72 GWh	0.60%	<b>*New Energy</b>

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

30-Sep-12


**Daily Owners' Mix for 29 September 2012**

<b>TNB</b>	59,834 MWh
<b>IPP</b>	230,384 MWh
<b>Co-Gen</b>	1,956 MWh
<b>Interconnection*</b>	(132) MWh

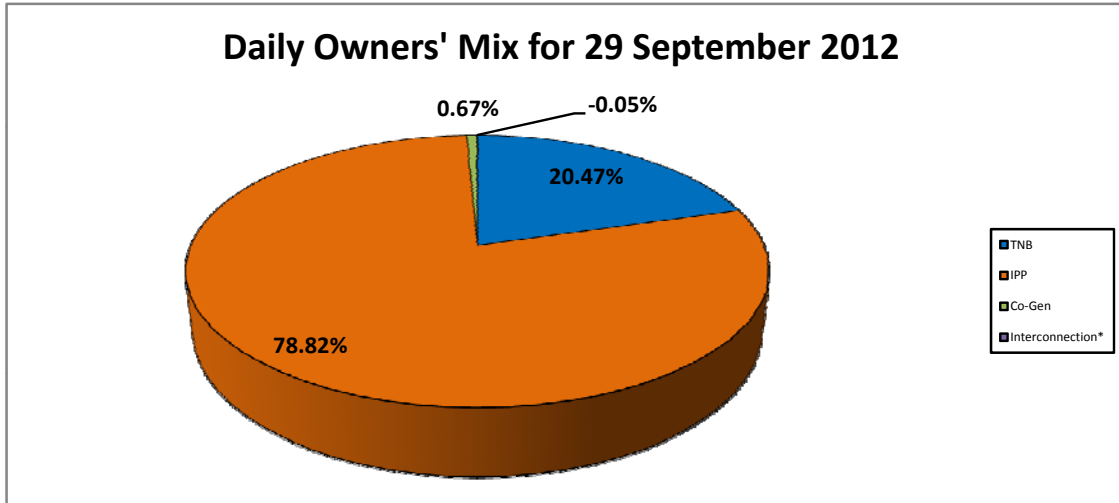

**Daily Generation Mix for 29 September 2012**

<b>ST-Coal</b>	124,656 MWh
<b>ST-Oil</b>	13,316 MWh
<b>ST-Gas</b>	- MWh
<b>Gas</b>	138,902 MWh
<b>Hydro</b>	13,344 MWh
<b>Distillate</b>	- MWh
<b>Co-Gen</b>	1,956 MWh
<b>SPORE*</b>	(829) MWh
<b>EGAT*</b>	697 MWh

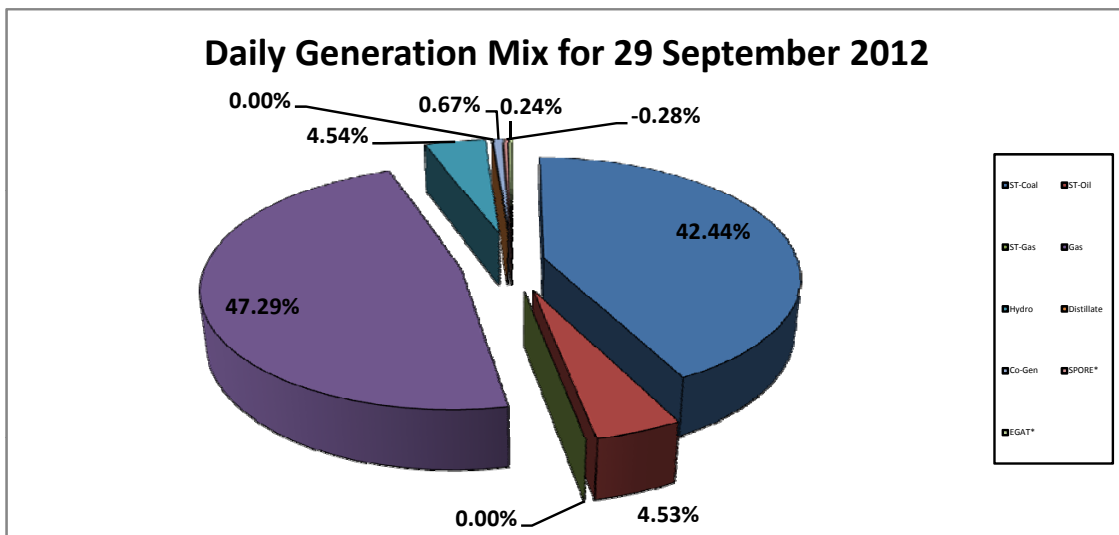

\*Negative = energy is imported from Singapore and Thailand  
 Positive = energy is exported to Singapore and Thailand